Fault Detection for Non-Condensing Boilers using Simulated Building Automation System Sensor Data

Rony Shohet¹, Mohamed Kandil¹, J.J. McArthur¹* ¹Department of Architectural Science, Ryerson University, Toronto, Canada

Abstract

Building performance has been shown to degrade significantly after commissioning, resulting in increased energy consumption and associated greenhouse gas emissions. Continuous Commissioning using existing sensor networks and IoT devices has the potential to minimize this waste by continually identifying system degradation and re-tuning control strategies to adapt to real building performance. Due to its significant contribution to greenhouse gas emissions, the performance of gas boiler systems for building heating is critical. A review of boiler performance studies has been used to develop a set of common faults and degraded performance conditions, which have been integrated into a MATLAB/Simulink emulator. This resulted in a labeled dataset with approximately 10,000 simulations of steady-state performance for each of 14 non-condensing boilers. The collected data is used for training and testing fault classification using K-nearest neighbour, Decision tree, Random Forest, and Support Vector Machines. The results show that the Support Vector Machines method gave the best prediction accuracy, consistently exceeding 90%, and generalization across multiple boilers is not possible due to low classification accuracy.

Keywords: Fault detection; machine learning; boiler emulator

1 Introduction

Heating, ventilation, and air condition (HVAC) systems play a fundamental role in maintaining comfortable indoor environments. However, their operation is not always perfect, where HVAC equipment faults can inhibit performance through various means. These faults include the degradation of equipment, failing of sensors, improper equipment installation, poor maintenance,

and improperly implemented controls [1]. These HVAC systems can be complex, and while streamed data is available, physical inspection – particularly of internal components – is often not possible, making fault detection and diagnosis a difficult task for building operators. The accumulation of faults can lead to increased energy costs, a loss of comfort causing a loss of productivity or loss of tenants, or increased wear of components, or decreasing reliability of equipment [1]. The impacts of these faults include approximately 15 to 30% waste of energy [2].

Building Automation Systems (BAS) provide centralized control for most building operations as well as sensor point monitoring, which can support fault detection and diagnosis (FDD). Collected sensor data provides an opportunity to develop a tool capable of evaluating performance of the observed physical system through FDD [3]. A fault has been defined as any deviation from the acceptable range of an observed variable [4]. FDD is an effective tool for evaluating system performance and has been broadly used in the automotive, nuclear, and aerospace sectors [3]. This approach has been more recently adopted within the building sector [3] because efficiency losses due to mechanical equipment degradation and poor controls can be significant and are well-addressed by this approach [5]. The goals of applying of FDD strategies on HVAC systems include improved indoor environmental quality, reducing unscheduled equipment downtime and maintenance costs, and increased equipment life [2].

An FDD tool can be developed through three generic approaches that are categorized by the source of a priori knowledge: model-based, processed based or a combination thereof. A model-based approach assumes no a priori knowledge is available, and the model is developed primarily from first principles. A process-history approach assumes there is a priori knowledge and the model is developed through relationships between collected sensor data. Finally, a combination of both develops physics-based models supported by collected sensor data.

Generating fault data using simulation is extremely valuable as it permits the modeling for complex fault scenarios (multiple concurrent faults) and is a way to inexpensively generate the bulk data necessary for algorithm development and testing [6]. Further, this approach permits data on rare or dangerous fault conditions to be generated without risk to the building or its occupants.

This paper focuses on the development of model-based FDD for instances where access to data from in-situ HVAC equipment is not yet available. A series of boiler emulators were created based on thermodynamic relationships modelled in MATLAB/Simscape and validated with manufacturer test data in nominal conditions. These were then used to create large labelled datasets of simulated nominal and fault condition data. Finally, different machine learning algorithms were used to develop FDD classifiers using only data available from typical BAS systems.

This paper contributes to the development of improved FDD in several ways. First, it presents a set of validated physics-based boiler model that can be used to generate simulated data for rare fault conditions. Second, it evaluated a range of potential machine learning algorithms and compares them for this context. Finally, the extent to which these classifiers can be generalized is evaluated across a variety of non-condensing boiler models.

2 Literature Review

The modelling of physical systems and the application of FDD techniques has been researched extensively within the HVAC industry. Generally, FDD is described as a three-step process: fault detection, fault isolation, and fault identification [3]. Fault detection determines whether any abnormal operation is occurring through measurements of sensor data. Fault isolation determines the location of the fault and the time of detection. Fault identification determines the nature of the fault and its significance in terms of impact on the overall system. These impacts can be quantified in terms of safety, costs, energy, comfort, or emissions. These decisions could include signaling an alarm, shutting down the system, reconfiguring the controls, or notifying facility management of necessary repairs. The primary goal of FDD is the early detection and diagnosis of faults, allowing for correction that would prevent further damage if left untreated. Therefore, often FDD applications require the observed system to be continuously monitored. A generic process of FDD has been discussed; however, there are many methods for the successful application of FDD.

The various methods of FDD are broadly categorized as quantitative model-based, qualitative model-based, and process history-based [3, 4, 7, 8]. Both quantitative and qualitative model-based

FDD utilize an understanding of the underlying physics of the system to develop relationships between inputs and outputs [3, 4]. However, quantitative model-based FDD creates a relationship between inputs and outputs from mathematical functions [3, 4]. While, a qualitative model-based FDD expresses the relationship through a qualitative understanding of the physical system for example expert systems [3, 4]. Meanwhile, the biggest difference between model-based approaches and the process history approach is the source of *a priori* knowledge used to evaluate faults. In model-based or *white-box* approaches [4], this knowledge is gathered from first principle relationships, whereas process history-based methods (*black box* approaches) gather this information from historical data correlations with no regard to the system physics [4]. Hybrid approaches combine both models and historical data using a *grey-box* approach. The following sections elaborate on the background and the recent FDD approaches beginning with model-based approaches.

2.1 Model-Based Approaches

The discussion begins with the FDD strategies used with a model-based FDD. It is assumed modelbased methods have a lack of sensor data; therefore, the parameters are often developed through an understanding of the underlying physics of the process. The quantitative model-based approach uses mathematical functions to define relationships between inputs and outputs of systems. Analytical redundancy is used to compare sensor measurements to model outputs ('analytically measured results') and uses the differences ('residuals') as inputs to the FDD algorithm [3]. Meanwhile, the qualitative model-based approach also uses a physical understanding of the system while observing qualitative relationships between inputs and outputs. , For example, an expert system, where a computer mimics the problem-solving methodology that a human expert would follow in order to come to a conclusion [3]. The goal of qualitative model-based is to encompass a detailed understanding of the system while avoiding the rigidity of numeric solutions that often overfit systems [7].

The development of a fault detection and diagnosis strategy requires modeling the HVAC equipment. White-box modeling uses physical laws and detailed knowledge of the process and equipment to create a model. The detailed knowledge is often complex and requires expertise in

understanding how to apply physical laws properly; imprecise assumptions that lack bearing in practice may thus result in poor accuracy [9]. The strength of white-box models lies in its ability to be generalized [9, 10, 11]. Unlike black-box models that are limited to the data domain used for training, white-box models can encompass a wider range of operating conditions, providing users with an increased understanding of how performance changes. Finally, the white-box model represents a system more closely as it uses specific knowledge of the inner workings of a system [9].

A model-based approach would require, first, a physical model of the HVAC equipment based on first principles and, secondly, an FDD strategy based on the physical model. Physical models using a white-box modeling strategy have been applied for a wide range of HVAC equipment, including Air Handling Units (AHU), cooling and heating coils, fan and pumps, chillers, and cooling towers [9, 10]. Many physical models of boilers have been developed and vary according to their level of detail, the calculation method, and input parameters [12]. Glembin et. al. [12] provide an overview of developed steady-state and dynamic boilers models. In addition, the authors discus the development of a low complexity dynamic boiler model. Complexity is minimized by utilizing a low number of input parameters, taken mostly from manufacture data. The dynamic boiler model proves to model steady-state performance highly accurately, while dynamic performance suffered from poor accuracy. Additional physical model of boilers includes Satyavada and Baldi [13], who developed a dynamic condensing boiler model. The boiler model formulates a set of partial differential equations that model condensing and non-condensing boiler operation upon infinitesimal elements. This model was extended by Baldi et al. [14] who performed model-based FDD on a condensing boiler model. The authors develop a strategy capable of detecting deviations of boiler efficiency and faults for sensors and actuator. This work also presents the novel idea of "virtual sensors", a method for estimating flow rates, that avoids the cost of installing expensive flow meters. Additional boiler models include, those developed by Haller et al. [15] who investigated the steady-state modeling of multiple fuels, including oil, gas, pellets and wood chips. The ASHRAE [16] three-component boiler model consisting of the combustion chamber, combustion gas-water heat exchanger, and a water-environment heat exchanger has been extensively referenced in these previously referenced works, as has the work of Bourdouxhe and Lebrun [17].

Despite the novelty of the discussed boiler design, most of the described boiler models lack a discussion of fault scenarios. As described by Li and O'Neill [6], most physical models of HVAC equipment assume normal operation with no failure points. A fault modeling scheme would allow the generation of faulty equipment performance, all the while providing data to allow testing and assessment of the FDD tool. In addition, by generating faulty data for a range of HVAC equipment (i.e., many boiler models), the robustness of the FDD scheme may be evaluated.

The white-box modelling of HVAC systems proves to be complex due to the interactions across multiple domains, including, thermodynamics, fluid mechanics, heat transfer, electro-magnetics, control systems, and electrical circuits [18]. Fortunately, there exist software capable of white-box modelling of HVAC equipment, including Modelica [19], Simscape [20], TRNSYS [21], HVACSim+ [22]. These modelling software handle many of the cumbersome differential equations present in HVAC components. This paper utilizes Simscape, a toolbox within MATLAB/Simulink for several reason. First, MATLAB, with or without Simulink, is broadly used for model predictive control, particularly the development of physics-based models to simulate system behavior. In addition, Simscape allows for the modelling of physical systems across multiple domains including electrical, mechanical, thermal, thermal liquid, two-phase liquid, gas, and moist air. Simscape avoids abstract mathematical equations through the application of component blocks, providing the designer with a user-friendly and simple design process. Each block represents a component of a physical system, allowing for multiple components to be combined through their respective energy flows. As for the design of the non-condensing boiler, the structure was inspired by the work presented by Mathworks [23]. This example demonstrates the application of a non-condensing boiler for the heating of a residential house. The components of the system – combustion chamber, heat exchanger, and a water source – were adopted for this research. The fundamental component of the combustion chamber was alleviated by this example [23]. The provided component could emulate the heat and mass transfer associated with combustion for any hydrocarbon fuels. The parameters within the heat exchanger component were modified for each boiler model according to manufacturer data. In addition, this paper leveraged the provided components to provide data on fault scenarios, including, increasing excess air within the combustion chamber and increasing fouling within the heat exchanger. The methodology of the parameter selection and fault modelling is described further in this paper. Several papers have been published that utilize Simscape for modelling of heating systems, however their modelling of boilers tends to be simplified. For example, several studies. [24, 25] and model the thermal dynamics of a heating system within a building, while avoiding direct simulation of a boiler. The heating source is designated as either a lumped model [24], or a heat source adjusted according to the necessary heat output required to achieve a temperature setpoint [25]. Another study [26] utilizes Simscape to model the performance of a boiler within a multizone residential building. The authors model the boiler manually by applying differential equations that calculate the heat generated. However, this task can be simplified by utilizing the heat exchanger component provided within Simscape. Dahash et. al. [27] present a comparison between EBILSON, a Modelica based simulation software, and a Simscape model for district heating system model. The research models a heat load, heat source, piping network and pumps with first principles. The heat source is simplified to model the dynamics of the water loop and assumes constant heat inputs. This research concludes that despite Simscape having less literature discussing its application towards physical modelling, it is as capable as Modelica to model complex physical systems [27].

The application of model-based FDD schemes has seen various non-heating HVAC applications. In one study, a model-based FDD of an entire HVAC system (central plant and terminal units) was modeled using support vector machines as the fault classifier. These authors simulated three faults individually: a stuck damper, cooling coil fouling/block, and a decreasing supply fan speed, each at three levels of degradation. The results of model-based FDD proved highly accurate to detect and diagnose individual faults at varying degrees. Zhou et al. [28] developed a similar model-based FDD strategy for an entire HVAC system, including the cooling tower, chiller, pumps, and heat exchangers. The authors provide a method of using performance indices to evaluate the residual between normal and faulty operation. The performance indices evaluate the effect of faults within each sub-system. The author presents fault models of fan motor degradation, condenser and

evaporator fouling, compressor motor degradation, partial clogs in pumps and pipes, and tube fouling, all of which are evaluated at two severity levels. The results indicate an ability to an ability to perform FDD accurately with increased severity levels. Finally, an ongoing study by the National Energy Renewable Laboratory investigates the application of fault modeling within HVAC simulations to develop FDD strategies [29].

2.2 Process History Approaches

The process history approach develops detailed models primarily from available data. Inputs and outputs are known and measured, and relationships are typically created through mathematical means including applications of statistical and non-statistical methods. Process history approaches have the strength of possessing knowledge and data throughout a systems lifecycle. However, the FDD scheme developed is only as accurate as the available training data, meaning re-tuning is necessary as more data is gathered. In addition, the process history method lacks physical significance, meaning that relationships are inferred based on correlations between the measured inputs and outputs but are not based on fundamental physical relationships [3]. Examples of applications of the process history method for HVAC equipment include: black-box models of residential HVAC equipment [30], FDD for water chillers using principal component analysis [31], and several review papers discussing the various applications of the many statistical and non-statistical methods for modelling HVAC equipment [3, 10, 11]. Again, there is a paucity of literature providing examples of the application of process history approaches for FDD to heating boiler systems.

2.3 Hybrid Approaches

The combination of model-based and process history approaches for modeling and FDD is referred to as a grey-box method. Generally, grey-box models are developed by utilizing a mathematical framework and derived parameters from sensor data [10]. Integrating the underlying physics to the model allows it to be physically meaningful. While the derived parameters are formulated from statistical or non-statistical methods from sensor data. The grey-box model offers improved accuracy compared to white-box and improved generalization compared to black-box [10]. A variety of HVAC equipment have used this approach, including the Gordon-Ng Universal Chiller

Model [32], which developed a relationship between the first and second laws of thermodynamics and was then calibrated specifically to the chiller using linear regression with collected sensor data. This grey-box model was then extended as an FDD tool for centrifugal chillers which successfully identified 5 different types of degrading chiller faults [33]. Afram and Janabi-Sharifi [34] presented a methodology for developing grey-box models of air handling units, energy recovery ventilators, buffer tanks, radiant floor heating, and a ground source heat pump. In this method, white box models were developed using energy balance equations, while parameters were estimated from collected data using a non-linear least-squares optimization technique [34]. Unlike the process history approaches, a handful of boiler-specific grey-box models were found in the literature. Farooq et al. [35] presented a methodology for modeling a low-pressure electric hot water boiler. The authors first modelled the stratified water temperature with energy balance equations in Simulink. While the parameters were evaluated from collected data using non-linear least squares optimization. The results of two cases of boiler performance were replicated with high levels of accuracy. Romeo and Gareta [36] present the results of a feed forward neural network model capable of identifying the amount of fouling present in a biomass boiler. As well, the author describes a second method for fouling detection with a thermodynamic model. The authors then combine these two models and show a quicker and more robust ability to predict fouling within biomass boilers then each separately. Teruel et al. [37] present a methodology for detecting accumulation of ash on furnace through the application of feed forward neural networks and sensor data from heat flux meters. The author states that using several subsets of neural network allows the model to have increased physical meaning. However, the author notes the complexity of performing the proposed task. Additional review of the literature indicates that modeling of boilers tends to focus on large-scale boilers commonly used in power plants; rather than those used in residential buildings.

2.4 Summary of Literature Review Findings

This review of the literature has shown that while boiler performance has been well-considered in the literature using model-based approaches, there has been little application of FDD within the heating context. The papers that study FDD applications towards heating elements have been found

to focus on industrial applications and are generally performed through hybrid modelling means [35, 36, 37] .. Therefore, research gaps are presented as such(1) there is a need for a validated white-box model capable of simulating boiler performance within the context of residential/multiunit residential, (2) creation of a dataset for various operating conditions, encompassing fault-free and faulty performance, and (3) development and evaluation of a FDD tool capable of distinguishing between the various faults that may inhibit boiler performance. The importance of this research gap is found within legacy buildings, which lack the necessary data for the successful implementation of process history based FDD. In addition, the literature tends to focus on singular boilers, ultimately creating FDD tools for highly specific situations [13, 35, 37, 36].

This research paper addresses these gaps by presenting a model-based application for boiler fault detection across a range of non-condensing boilers, with a focus on the machine learning algorithms most effective for individual and generalized fault detection and classification. The Simscape heating system model [23] described above was determined to be the most effective starting model based on those reviewed, in part because Simscape offers the ability to model both steady-state and dynamic performance, there have been various applications within research papers focused on modelling of heating [24, 25, 26, 27], as well as providing the fundamental components necessary to model this system. The classification algorithms considered as potentially useful for this research include Random Forest [38], Decision Trees [39], and k-nearest neighbour [40] and Support Vector Machines [41]. The most promising trained models were then tested using a range of non-condensing boilers to test the generalizability of this approach.

3 Methodology

The methodology for developing an FDD tool for non-condensing boilers is presented. This research was undertaken in three steps: (1) development and validation of a boiler emulator capable of simulating normal operation and operation under key fault conditions; (2) simulation of fault condition dataset; and (3) creation of a testing and training dataset for a machine learning model to identify fault conditions based on standard building monitoring system data points. These three steps were repeated for a set of boilers representing a full range of sizes from a given manufacturer

(the Viessmann Vitorond 200 series) as well as two boilers from a second manufacturer (Raypak) so that results across boiler sizes and manufacturers could be compared to evaluate the ability for the resultant classification algorithm to be generalized.

3.1 Emulator development and validation

Fundamentally, a steady-state boiler may be divided into two components as described in [16]: the combustion chamber and a heat exchanger. Simscape provides many of the components necessary for the development of this boiler, including a heat exchanger, water loop pump and a component that models combustion. These components were assembled to create the boiler emulator. The following discussion highlights fundamental first principle concepts necessary to ensure modelling accuracy.

The model assumes the combustion chamber is adiabatic, that complete combustion occurs in the normal operation case, and that the input fuel (natural gas) can be assumed to be pure methane. The products of reaction are assumed to include only carbon dioxide, water vapor, oxygen, and nitrogen; i.e. incomplete combustion is not permitted in this model in the normal case. The general combustion reaction equation with hydrocarbons is formulated in Eq. 1, where x and y signify the number of carbon and hydrogen molecules, respectively. Eq. 1 provides the fundamental chemical relationship between the inputs and outputs of the combustion chamber.

$$C_{x}H_{y} + (1+Z)\left(x + \frac{y}{4}\right)(O_{2} + 3.76N_{2}) \rightarrow$$
(1)
$$\frac{y}{2}H_{2}O + xCO_{2} + (1+Z)\left(x + \frac{y}{4}\right)3.76N_{2} + Z\left(x + \frac{y}{4}\right)O_{2}$$

The inputs of the combustion chamber include the mass flow rate of the fuel, the temperature of outdoor air, humidity ratio of outdoor air, and temperature of the fuel. The mass flow rate of the fuel was found using Eq. 2. The formula is used within *ANSI/AHRI Standard 1500: Performance Rating of Commercial Space Heating* [42]. Typically, manufacturers provide an input rating for their boilers, while the higher heating value (HHV) is a property attributed to the type of fuel. The flow rate of combustion gas establishes the magnitude of the heat generated through combustion.

$$\dot{m}_{gas} = \frac{Q_{in}}{HHV_{gas}} \tag{21}$$

Properties of outdoor air were selected to reflect a relative humidity of 65% at various outdoor air temperatures. While the fuel temperature was left constant and unchanged from the default value of 303 K. Figure 1 depicts the boiler emulator developed in Simscape with the combustion chamber along with its inputs shown. Before calculating the output of the combustion chamber, parameters within the component must be defined to calculate outputs. Specific heat capacities, fuel heating values, and boiler geometries were assumed to be constant for each individual boiler, as summarized in Table 1. Note that while the inlet fluid temperature is assumed constant, this is due to the fact that this is true instantaneously and given the speed with which steady-state is achieved (typically less than 15 seconds, which is a typical-to-fast sampling rate for a BAS), this was determined to be an acceptable assumption for these models. A range of inlet temperatures was simulated to create the training dataset, thus capturing the longer-duration change in this parameter.

Component	Parameter	Value and Source
Boiler	Hydrocarbon lower heating value	50MJ/kg [6]
	Fuel specific heat at constant pressure	2191 J/kg/K [6]
	Dry air specific heat at constant pressure	1005 J/kg/K [7]
Gas/Water Heat Exchanger	Flow arrangement	Shell and Tube [8]
	Number of shell passes	2 [8]
	Wall thermal resistance	0 K/W [9]
	Hydraulic diameter for pressure loss	101.6 mm [8]
	Thermal liquid volume	0.275 m ³ [8]
	Thermal Liquid - Initial temperature	333 K [8]
Water Mass Flow Rate Source	Cross-sectional area at ports A and B	0.1 m ² [8]
PS Constant – Temperature Fuel	Constant (Temperature)	303 K [8]

Table 1. Summary of Constant Component Parameters Across All Boilers

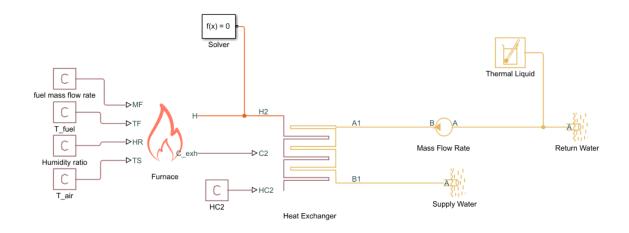


Figure 1. Boiler emulator developed in Simscape.

The only parameter that was necessary to calculate and validate was the Percent Excess Air or the (1+Z) term within Eq. 1. The value of excess air was validated according to the manufacturer specifications, often provided as either the amount of CO₂ or O₂ present in the flue gas. The combustion reaction results were replicated by calculating the mass percentage of the specified gas product. General expressions for these ratios are presented in Eq. 3 and 4.

$$%CO_{2} = \frac{xCO_{2}}{\left(\frac{y}{2}H_{2}O + xCO_{2} + (1+Z) \ 3.76N_{2} + Z\left(x + \frac{y}{4}\right)O_{2}\right)}$$
(3)
$$%O_{2} = \frac{Z\left(x + \frac{y}{4}\right)O_{2}}{\left(\frac{y}{2}H_{2}O + xCO_{2} + (1+Z) \ 3.76N_{2} + Z\left(x + \frac{y}{4}\right)O_{2}\right)}$$
(4)

The volume percentage of CO₂ and O₂ varies depending on the amount of excess air present during the reaction. The boilers were validated for the Vitorond boilers based on 10% CO₂ present in the exhaust gas, as defined in the manufacturer specifications [43]. The outputs of the combustion chamber include combustion gas temperature, and heat capacity rate of combustion gas, and the heat generated through combustion. The temperature and heat capacity rate provide the necessary inputs to the combustion gas-water heat exchanger, while the heat generation is used to determine the efficiency of combustion. The heat exchanger was assumed to be a two-pass shell-and-tube, with water in the tubes and combustion gas in the shell. The mathematical analysis used the effectiveness-NTU method [44]. Unlike the combustion chamber, the model parameters within the gas-water heat exchanger component are unique for each boiler model. The parameters that encompass these unique details of boilers include the thermal liquid volume, heat transfer surface area for the tube-side and shell-side, and heat transfer coefficients. Most of these values are found within manufacturer literature. For example, the literature for the Viessmann Vitorond 200 VD2 series provides thermal liquid volume and heat transfer surface area for each of their boiler models within the series, allowing the model to fit manufacturer specifications for 11 unique boiler models [43]. Liquid-side heat transfer coefficients are kept as the default value within the component and were assumed to be constant while the calculation of gas-side heat transfer coefficients is discussed further.

The importance of the noted parameters is due to the mathematical relationship when performing heat exchanger analysis. The equation for the overall heat transfer coefficient of a heat exchanger is presented in Eq. 5, which shows the fundamental relationship between the heat transfer coefficient and the geometry of the heat exchanger. Simscape implements these equations used for heat exchanger analysis, simplifying the modeling process. Regardless, inputs must be provided either from manufacturer data or through calculation.

$$UA = \frac{1}{h_i A_i} + \frac{R_{f,i}}{A_i} + \frac{\ln\left(\frac{D_o}{D_i}\right)}{2\pi kL} + \frac{R_{f,o}}{A_o} + \frac{1}{h_o A_o}$$
(5)

The inputs for the heat exchanger model include the thermal liquid side and the gas side. The thermal liquid side inputs assume the liquid within the heat exchanger is water. The inputs include the mass flow rate of the water, return water temperature, and water pressure. Manufacturers provide these values since they provide the test conditions used for measuring the performance of boilers. The gas-side inputs include the outputs of the combustion chamber, the discussion of which has been presented.

A key parameter within the gas side of the heat exchanger includes a heat transfer coefficient of the combustion gases. Calculating the heat transfer coefficient was an iterative approach using manufacturer data of known operating conditions. The provided values of the temperature difference between supply and return water, the flow rate of the water, the heat output, and combustion and thermal efficiencies are evaluated with each iteration of the heat transfer coefficient. A flow chart depicts the calculation of the heat transfer coefficient (Fig. 2). The outputs reflect the operating conditions of the boiler model based on manufacturer data. The logic of the flowchart acts as a method for the validation of the boiler. The model was deemed valid once the simulated results were within an acceptable tolerance of the manufacturer's data. This method assumes that the heat transfer coefficient is constant throughout its operation. In addition, the results are further validated by simulating and evaluating performance of the model according to additional datapoints provided by the manufacturers. The results of the evaluation indicate that the assumption of a constant gas-side heat transfer coefficient is a valid one for each boiler over the operating range

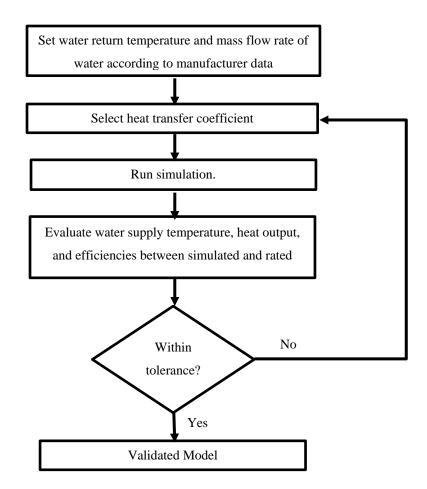


Figure 2. The iterative approach used for calculating gas-side heat transfer coefficient

The discussion has shown the methodology used to develop a model of a boiler using primarily manufacturer data and test conditions outlined by standards. The validity of the model was evaluated by comparing outputs published by the manufacturers to those simulated within Simscape. One final metric that evaluates the validity includes calculations of non-condensing combustion efficiency and thermal efficiency, as outlined in BTS-2000 [45]. First, non-condensing combustion efficiency calculates the efficiency of the boiler considering flue gas heat losses. Generally, the equation is formulated as:

$$Effy_{ss} = 100 - L_f \tag{6}$$

 L_f represents the flue losses in the exhaust gas, which is a function of the amount of CO₂ present in the exhaust gas, the relative humidity of air supplied during combustion, the flue gas temperature,

room temperature, and several provided constants [45]. To evaluate the combustion efficiency, it is necessary to calculate the temperature of the flue gas. This was performed by first obtaining the properties of water for the inlet and outlet and the properties of gas for the inlet, all of which are calculated by the Simscape component. It assumed no heat loss occurred; therefore, a heat balance between the three known states can be performed. This means the heat received by the water side is the same as the heat rejected by the gas side. Thus, the properties of the exhaust gas and the non-condensing combustion efficiency can be calculated. Finally, the thermal efficiency of the boiler is calculated considering the heat input and heat output. The heat input is found using Eq. 7 while the heat output is found through the simulation outputs. Thermal efficiency is thus calculated with Eq. 8.

$$Q_{in} = \dot{m}_{gas} \times HHV_{gas} \tag{7}$$

$$\eta = \frac{Q_{out}}{Q_{in}} \tag{8}$$

Therefore, the validation of the boiler is achieved by evaluating the temperature of water and exhaust gas, products of exhaust gas, the flow rate of water, and thermal and non-condensing combustion efficiency.

3.2 Development of a classifier training dataset for FDD

In order to be practically useful, it is important that the most readily available parameters be used as input features for classifier training. To this end, the key control and sensor points from a BAS, namely entering and leaving water temperatures, pump VFD speed, outdoor air temperature, and room (fuel) ambient temperature. Initially the gas consumption rate was also considered, however this was difficult to measure in a series of case study buildings currently underway, and flue gas temperature (using a data logger on a thermocouple sensor) was considered in lieu.

The purpose of this dataset is to train machine learning models to classify field data to detect or predict fault conditions. Because it is highly undesirable to run boilers in significant fault mode (extremely high excess air, or permitting boilers to operate after scaling and/or fouling are known

to be present and significant), this is highly valuable to classify The dataset can be used to supplement logged data where certain faults have not yet occurred, and thus, the real-world data is unavailable. This provides insight on boiler operations prior to significant performance degradation or failure

A range of common boiler faults was incorporated through fault modelling: gas-side fouling (0.01,0.06,0. 11,...,0.46), water-side scaling (0.01,0.06,0. 11,...,0.46), and excess air (0.05, 0.1, 0.15,...,0.5). The performance of heat exchangers typically deteriorates due to the accumulation of deposits on the heat exchanger surface. Fouling increases the resistance to heat flow, therefore worsening the performance of the heat exchanger. This fault is represented as the fouling factor, R_f, the second and fourth term in Eq. 5. In practice, boilers operate with a certain amount of excess air for safety and maintenance reasons. Excess air is often introduced because it prevents incomplete combustion, the products of which include carbon monoxide, unburned fuels, soot, and surface fouling. However, as more excess air is introduced, the combustion efficiency decreases. An increased percentage of excess air causes a reaction to contain increased amounts of Nitrogen and Oxygen gas in the products, which absorb useful heat that is exhausted to the atmosphere, resulting in high losses. The modelling of excess air was performed by varying the inputs of equation 1, where term Z represents the percentage value of excess air. Fault modelling of excess air included simulating a range of excess air percentages. Table 2 provides a summary of the ranges used for fault modelling.

Fault (Label)	Component	Variable	Nominal Value	Tested Range
Excess air (X)	Boiler combustion chamber	Air flow rate	0	5% - 50%
Gas-side fouling (F)	Gas-Water heat exchanger	Fouling factor (%)	0	F = 0.01 - 0.46
Water-side Scaling (S)	Gas-Water heat exchanger	Scaling factor (%)	0	S = 0.01 - 0.46

Table 2. Summary of variables, faults and emulator implementation

The boiler model was simulated with a variety of normal operating conditions in addition to these individual faults. The results of the simulations were used to generate a dataset intended to complement logged data from a BAS. As noted previously, only data points that are observed

within BAS were used to generate the dataset: the water flow rate, entering and leaving water temperatures, outdoor air temperature, gas consumption rate, and flue gas temperature. These outputs were collected and labelled with the associate fault. Iterations were performed, changing the gas fuel flow rate, water mass flow rate, outdoor air temperature, return water temperature, and the three faults. This fault modelling methodology was performed for 14 non-condensing boilers resulting in datasets with thousands of simulations for each.

3.3 Classification using machine learning

Several machine learning classification algorithms were tested on each of the generated datasets to create an FDD classifiers capable of analysing the input feature data and determining the nature of the fault.

Consistent with best practices for machine learning research, a selection of common classification algorithms was tested for their ability to distinguish between normal operation and each fault, informed by the literature review. These were namely K-nearest neighbour (KNN), Decision Trees (DT), Random Forest (RF), and Support Vector Machines (SVM). The algorithms were programmed in Python using Scikit-learn [46], which was used for model training, testing, evaluation, and result visualization. The procedure of evaluating classification ability requires first splitting the data into 80% training/cross-validation set and withholding 20% for tuned algorithm testing. This split was consistent for all algorithms tested and a 5-fold cross-validation method was used. Each machine learning algorithm was evaluated by performing a hyper-parameter search in conjunction with cross-validation, as summarized in Table 3. Grid Search was performed to evaluate an array of hyper-parameters which trained the algorithm with all possible combinations of parameters.

Algorithm	Hyper-parameter tested	Range
K-nearest neighbour	K Number of Neighbours	{3,5,7}
Decision Trees	Maximum Depth	{5,10,15,20}
	Minimum Leaf Samples	{1,2,5,10}
	Minimum Split Samples	{2,5,10}
	Criterion	{Gini, Entropy}
	Splitter	{Random, Best}
Random Forest	Maximum Depth	{ }
	Minimum Leaf Samples	{1,2,5,10}
	Minimum Split Samples	{2,5,10}
	Number of Estimators	{100,250,500,750}
Support Vector Machines	Kernel	{Radial Basis Function}
	Gamma	{0.1,1,10}
	С	{100, 5 000, 10 000}

Table 3 Hyperparameter Searches by Algorithm

The result of hyper-parameter tuning and cross-validation is a re-trained model with optimized classification results. The best hyper-parameters are applied to the testing data and classified. The result of the classified test data is evaluated through the scoring metrics: accuracy, precision, and recall.

The level of classifier precision was varied through this research. Initially, the FDD classifier was used to predict the exact fault category (i.e., fouling = 5%). Based on preliminary results, it was noted that there was substantial error between adjacent categories, particularly for excess air, and a revised approach was used where all excess air faults were labelled the same. This simplification of classes was further repeated until only the fault type but not the degree was classified.

3.4 Evaluation of Generalizability

The developed machine learning models were evaluated on their ability to perform classification on various iterations of datasets. The goal of this study is to assess the ability to generalize boiler performance by observing whether the machine learning models can retain a high classification accuracy despite inputting iterations of datasets. A model that remains high in accuracy would be considered generalized it were capable of not only distinguishing nominal and faulty performance of an individual boiler but also nominal and faulty boiler performance across multiple boilers. The evaluation of the models' ability to generalize is performed in several iterations, 1) training on midrange boiler and testing on separate boilers of same manufacturer; 2) training on the entire dataset and testing on the entire dataset; 3) training on the entire dataset and testing on individual boilers; and 4) training on a set number of boiler models and testing on the remainder. Throughout each studies the hyperparameters were kept constant such that the most optimal hyperparameters are selected during the grid search. The training and testing were split 80% and 20% respectively for each study. The datasets used throughout these studies were the 22-class since their performance was found to provide the highest classification accuracy in the single-boiler models.

4 Emulator Validation

A set of 14 non-condensing boilers was selected for this research, expanding upon an initial study considering a single boiler. These 14 included the full 11 models within the Viessmann Vitorond 200 boiler series, along with the Viessmann Vitogas 050 ECV-200, Raypak Raytherm 685-T, Raypak Raytherm H3-724. These models were created to support future case studies with local institutional and multi-unit residential building operators.

The emulator was simulated for each of the Viessman Vitorond 200 series models using manufacturer data to tailor the model parameters. Validation observed 5 outputs: thermal output, combustion efficiency, thermal efficiency, water supply temperature, and temperature of exhaust gas, all of which provided by the manufacturer. These outputs are gathered once the simulated boiler reaches steady-state operation. The accuracy of the simulated model is evaluated by comparing each of the outputs to the manufacture specifications. Figures 3 and 4 compare of thermal output and thermal and combustion efficiency respectively across all models tested.

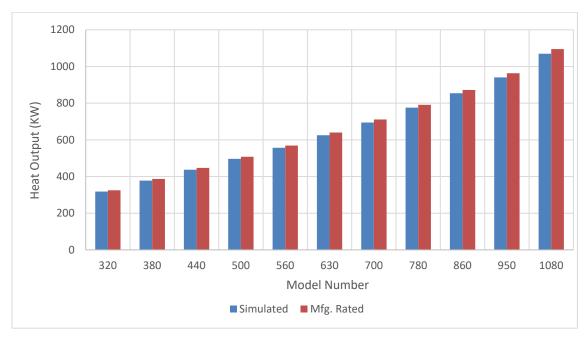


Figure 3. Viessmann Vitorond 200 Boiler Series Thermal Output



Figure 4. Viessmann Vitorond 200 Thermal and Combustion Efficiency

A summary of the accuracy for each output is tabulated in Table 3 across all boilers. The efficiencies have an error below 2.5% and generally underestimate the efficiency of the boiler. The

exhaust gas temperature shows a high level of accuracy, with an average error of nearly 0%. However, individually, the exhaust gas temperature tends to fluctuate from the expected steadystate output by roughly +/- 3°C. The water supply temperature was consistent between each boiler model; however, suffered from underestimating by roughly 1.5°C. Finally, the thermal output of each model was generally underestimated heat output with an average of 2% error. These were deemed to be acceptable results and avoided the arbitrary tuning of values from a previously validated boiler model.

	Combustion Efficiency	Thermal Efficiency	Exhaust Gas Temperature	Water Supply Temperature	Thermal Output
Average	1.71	1.85	0.02%	0.441%	2.234%
Minimum	1.42	1.63	-1.66%	0.386%	1.952%
Maximum	2.02	1.98	1.47%	0.458%	2.406%

Table 4. Validation Error for Viessmann Vitorond 200 series

Following the validation of the Vitorond 200 series, the Raypak Raytherm 685-T, Raypak Raytherm H3-724, and Viessmann Vitogas 050 ECV-200 were modeled and validated using a similar methodology. Unfortunately, the validation of exhaust gas temperature and combustion efficiency could not be considered during the validation because of a lack of manufacturer data. The results of the validation are summarized in Figure 5.

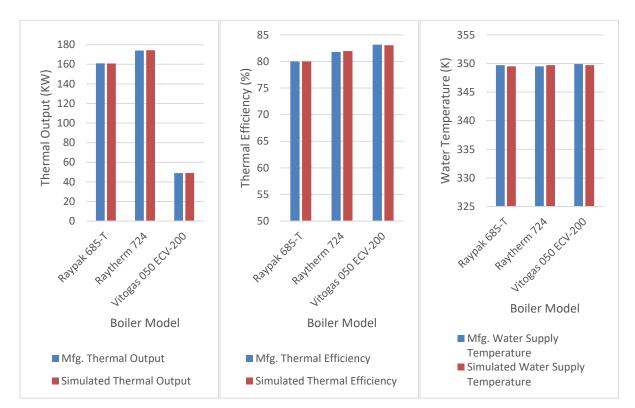


Figure 5. Summary of Boiler Validation for Three Models

The validation accuracy of the simulations, when compared to the data points provided by the manufacturer, proves to be highly accurate. Comparing the average percent validation errors of thermal output 0.05%, thermal efficiency 0.025%, and water supply temperature 0.02%, this validation was deemed successful.

As mentioned in the methodology, manufacturers provide additional datapoints of water temperatures at various water flow rates. Evaluating the performance of the simulation with these datapoints allows the model to be further validated. Simulations were performed with the provided water flow rates and the results of the output temperature are compared between the simulation and manufacturer data. Table 5 summarizes the results of simulation of the additional datapoints. Note that only the best and worst-performing Vitorond models are indicated in the table for brevity. The average error for these boilers was -0.009 K (range 0.1-0.8 K).

Manufacturer/Model	Water Mass Flow	Expected Delta	Achieved Delta	Error
	Rate (kg/s)	Temperature (K)	Temperature (K)	(K)
Vitorond 200 – 860	18.5	11.1 (20 F)	10.9	0.2
(most error)	9.3	22.2 (40 F)	21.8	0.6
Vitorond 200 - 320	6.9	11.1 (20 F)	11.0	0.1
(least error)	3.4	22.2 (40 F)	22.2	0.0
Vitogas 050	1.05	11.1 (20 F)	11.1	0.0
	0.69	16.6 (30 F)	16.9	0.3
Raypak 745	5.68	7.2 (13 F)	7.3	0.1
	2.52	16.6 (30 F)	16.5	0.1
Raytherm 685-T	6.31	5.5 (10 F)	6.1	0.6
	3.47	11.1 (20 F)	11.1	0.0
	2.33	16.6 (30 F)	16.5	0.1

Table 5. Results of Additional Datapoints Post-Validation

5 FDD Prediction Results

This section presents the results of applying machine learning classification as an FDD tool and evaluates the performance of each classifier across all boiler models. Each boiler model was simulated with constant input conditions without any faults present, thus generating the normal operation for each boiler. The following simulations observed the same input conditions; however, three unique fault models were incorporated. The fault models were simulated individually, which provides data for the progression of increasingly more detrimental operation. The outputs - fuel mass flow rate, the temperature of combustion air, water return and supply temperature, and water mass flow rate – were collected along with a label identifying the class of simulation (i.e., Normal, Fouling = 0.05, etc.). The datasets associated with the performance of each boiler is used as the basis for developing the FDD tool. The FDD tool was developed by using four machine learning classification algorithms: Decision Tree (DT), Random Forest (RF), K-Nearest Neighbour (KNN), and Support Vector Machines (SVM). The results of each classifier on each boiler are discussed, allowing each individual classifier to be evaluated as an FDD tool. Each machine learning classification algorithm can technically perform as an FDD since they each perform classification. However, accuracy must be preserved to ensure the FDD tool is practical. An accurate classifier is one that correctly labels data points for the entire dataset. Therefore, this discussion will evaluate the four machine learning algorithms with accuracy, referring to the ability of a classifier to label

BAS data points correctly. Tables 6 & 7 summarize the prediction accuracy for each classifier and boiler.

Classifier	Viessmann Vitorond Boiler Series Number										
Classifier	1080	950	860	780	700	630	560	500	440	380	320
KNN	2.8%	2.4%	1.8%	2.1%	1.6%	1.8%	2.4%	1.4%	1.3%	1.6%	1.4%
DT	60.0%	61.0%	60.1%	59.9%	58.6%	59.7%	66.9%	58.3%	57.8%	57.8%	55.7%
RF	57.1%	58.7%	57.1%	57.5%	57.9%	57.3%	64.6%	54.4%	54.4%	55.9%	55.3%
SVM	81.8%	82.2%	81.5%	81.2%	81.0%	81.0%	83.6%	80.3%	79.6%	80.0%	78.5%

Table 6. Viessmann Vitorond FDD Accuracy Comparison

Table 7. Raytherm and Viessmann FDD Accuracy Comparison

		Boiler Mode	el
Classifier	Raypak 685-T	Raypak 724	Vitogas 050 – ECV 200
KNN	27.7%	23.8%	24.9%
DT	70.4%	66.8%	60.5%
RF	66.2%	65.2%	57.6%
SVM	80.4%	79.7%	73.3%

The results of the hyperparameter selection show a range of varying results unique for each boiler. The hyperparameter 'number of neighbors' for KNN varied between 5 and 7 throughout each boiler model. As for DT, the hyperparameter 'criterion' varied between the two options. While RF varied for the hyperparameter 'number of estimators' for all models. The only positive results were seen with SVM, which had constant values for 'C' and 'gamma' for every boilers dataset.

The classification accuracy of each model is investigated further through observation of the confusion matrices. The results of classification accuracy remain consistent between each of the 14 boiler models; therefore, the following discussion will focus only on a few boilers to remain concise. Firstly, the most prominent issue observed is the confounding of the excess air categories across each boiler within the RF and DT, and less in SVM classifiers. As seen in Fig. 6 adjacent categories are often mislabeled. This is most likely a result of the boiler performance varying minimally with small changes in excess air percentage. Low classification accuracy for nominal performance, which is highly confounded with 5% excess air, which is consistent with the inability

for the classifier to detect a 5% change in excess air. SVM classifies normal performance at an accuracy of 62%, RF and DT is roughly 40%, and KNN is 0%. The confounding error between excess air faults and normal performance disappears above 10% excess air for all of RF, DT, and SVM.

Water scaling and air fouling at low percentages (up to 11%) are often misclassified by RF, DT, and SVM classifiers, again because at these levels their effect on boiler performance is limited. Surprisingly, there was particularly high confounding between 11% fouling and 5% water scaling but at higher fouling and scaling values, they are readily distinguished. KNN classifies with poor accuracy, suggesting the dataset is insufficiently distinct between neighboring datapoints causing significant misclassification. Upon evaluation of the results of each classifier, modifications to the dataset were performed to improve prediction accuracy.

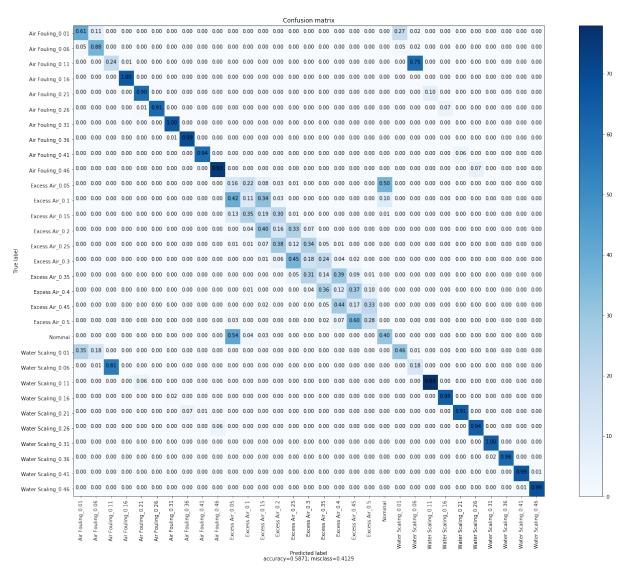


Figure 6. Vitorond 950 - Random Forest {'bootstrap': True, 'Maximum Depth': None, 'Maximum Features': 5, 'Minimum Leaf Samples': 1, 'Minimum Split Samples': 5, 'Number of Estimators': 750}

Modifying the datasets to improve accuracy was performed first by categorizing excess air as a single class. This was justified by understanding that excess air faults result from stuck outdoor air dampers and this is not a problem that is known to progress over time. In this classification scheme, all cases of excessive air percentages were labeled as "Excess Air". The results were a significant improvement in accuracy. Figure 7 depicts the results of random forest for the Vitorond 950 with a modified dataset, the accuracy of which is 85.8%, an increase of 27.1%.

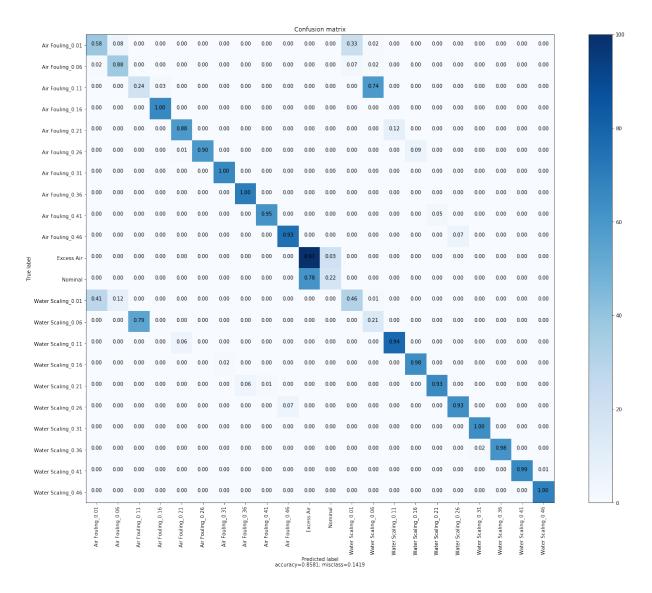


Figure 7. Vitorond 950 – Random Forest with Single Excess Air Class {'bootstrap': True, 'Maximum Depth': None, 'Maximum Features': 5, 'Minimum Leaf Samples': 1, 'Minimum Split Samples': 2, 'Number of Estimators': 100}

Following the discussed modification, the effect of broadening each class label was observed. Instead of 31 detailed class labels, 4 broad categories are provided, where classification is performed with each fault category. The goal is to have misclassifications between adjacent faults of the same type ignored, ideally further improving accuracy. The observed results for the categorical classification with random forest classifier on Vitorond 950 are presented in Figure 8, the accuracy of which is 86.4%, an increase of 27.7% from the primary classification model.

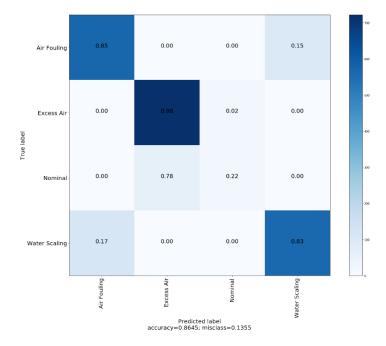


Figure 8. Vitorond 950 – Random Forest with 4-class classification {'bootstrap': True, 'Maximum Depth': None, 'Maximum Features': 5, 'Minimum Leaf Samples': 1, 'Minimum Split Samples': 4, 'Number of Estimators': 500}

The categorial classification scheme proved unnecessary as the change in accuracy was minimal in comparison to the first modification. It was assumed preventing inter-class misclassification would improve accuracy; however, their impact on overall accuracy is limited. As well, the accuracy of the best classifier, SVM, was impacted severally by the categorical classification. The full condition classification allows for increased granularity in prediction. This is important because it permits a more precise diagnosis of the specific fault occurring within the boiler. Therefore, the overall accuracy of a categorical classification proves to be poorly suited for FDD.

A summary of the results for several boiler models after each dataset modification are presented in the following tables. Due to the consistently poor performance of KNN, its are omitted.

		Viess	mann Vitor	Ray	pak	Viessmann Vitogas 050		
Classifier	1080	950	560	440	380	685-T	H3- 724	ECV 200
DT	85.6%	86.5%	91.4%	85.6%	83.5%	87.6%	85.3%	78.9%
RF	85.4%	85.8%	93.1%	82.7%	83.8%	89.0%	89.5%	82.1%
SVM	93.0%	93.2%	94.9%	91.1%	91.4%	93.3%	93.1%	88.5%

Table 8. Single Excess Air Categorization (22 Class) Accuracy Summary

Table 9. Categorical Classification (4 Class) Accuracy Summary

	Viessmann Vitorond Raypak						Viessmann Vitorond Raypak V Vi			
Classifier	1080	950	560	440	380	685-T	H3-724	ECV 200		
DT	82.5%	84.3%	96.3%	81.2%	83.5%	88.2%	86.5%	80.9%		
RF	84.9%	86.5%	96.3%	82.9%	84.8%	89.2%	88.8%	83.5%		
SVM	78.5%	78.4%	98.0%	77.7%	78.7%	89.6%	89.3%	85.5%		

It is noteworthy in the above table that the Vitorond 560 model was more accurately classified than all other boiler models. More specifically, when comparing the SVM classifier, all hyperparameters are constant across each boiler model, yet the performance of the FDD is significantly more accurate. The reason for this is unclear and may be due to it being of a moderate size – larger boilers may not show the same distinction between adjacent classes at low fouling and scaling percentages, whereas the ranges of performance in smaller boilers may lead to confounding. Modeling of other boilers of this size would be necessary to confirm or correct this hypothesis.

Evaluating the hyperparameters after modifying the dataset shows similar parameter selection to those of the unmodified dataset. DT exhibited a similar issue of varied 'criterion' selection for each boiler model. RF varied with the 'number of estimators' and 'minimum samples split,' while 'minimum leaf samples' remained constant. SVM exhibited constant hyperparameter selection with a 'C': 10000 and 'Gamma': 0.1, across all boiler models.

5.1 Generalization

One of the benefits of observing multiple boiler models and their performance with the various machine learning classifiers was the potential to evaluate their generalization potential. Two

aspects of generalization were considered – first, the form and hyperparameters of the individual models, and second, the ability to iteratively manipulate the dataset to observe performance of single boilers. In the first case, a degree of generalization was observed using the 22-class boiler model. For all boilers, the SVM classifier was most accurate, and the hyperparameters were consistent (Gamma = 0.1 and C = 10000). This suggests that this methodology can be readily applied to other non-condensing boilers with the expectation of high prediction accuracy.

The second study observed four iterations of manipulated boiler datasets. This study sought to evaluate the ability to generalize individual boiler performance accurately. A generalized boiler FDD approach would allow this methodology to be extended towards new unlabeled boiler models, without the need for the development of a training dataset using the emulator. The four iterations include: 1) training on one boiler and testing on similar sized boilers; 2) collecting all the boiler datasets, training on the collected dataset and testing on individual boiler datasets; 3) collecting all the boiler datasets, training on 80% of the collected dataset, and testing on the remaining 20% of the collected dataset; and 4) each classifier was trained on all boilers except the Vitorond 950, 630, 500, 380, Raypak 685 and Vitogas 050, while the testing was performed on the withheld boiler datasets. Table 10 summarizes the results of the classification models. The classifier accuracies for iterations 1 and 4 are summarized for the algorithms with the highest achieved accuracy (SVM, DT and RF, respectively) while iteration 2 shows the average accuracy across all boiler models tested.

Iteration Number	Training Input	Testing Input	Classifier Test Accuracy
1	Vitorond 560	Vitorond 1080	31.9% SVM
		Vitorond 630	49.9% SVM
		Vitorond 500	64.0% SVM
		Vitorond 440	39.7% RF
		Vitorond 320	54.6% SVM
2	Collected boiler dataset	Individual boilers tested one at a time	84.0% DT* 85.1% RF * 54.0% SVM*
3	Collected boiler dataset	Collected boiler dataset	85.0% DT 86.3% RF 55% SVM
4	Vitorond 1080, 950, 860, 780, 700, 560, 440, 320	Vitorond 630 Vitorond 500 Vitorond 380	50.8% SVM 49.6% DT 44.6% SVM
	Raypak 724 Vitogas 050	Raypak 685	34.2% SVM

Table 10. Boiler Model Generalization Results

^{*}indicates average accuracy across all boiler models tested

The results of the various iterations generally show poor ability to generalize. The first study indicates that training on a single boiler was not applicable to predict fault in boilers of similar sizes from the same manufacturers. It was observed that the results of classification are accurate for classification of excess air, the test results distinguished nominal and excess air reasonably accurately with minor confounding between the two classes. However, many of the inaccuracies are a result of misclassification of fouling and scaling with no noticeable trends in the confusion matrices for the Vitorond 1080 and 320. , In contrast, the relative best performers, Vitorond 500 and Vitorond 630, with both cross-fault error (i.e. low rates of fouling confused with low rates of scaling) and intra-fault error (confounding between different levels of the same fault), however normal and excess air were well-distinguished, as were the higher degrees of scaling. This improved performance may be a result of an overlap in performance characteristics between the training and testing input, namely the similarity boiler geometry, heating output, and mass flow

rates for gas and water. However, the accuracy of the classifier shows that the overlap is insufficient to perform accurate FDD. The second iteration showed promising results, with accuracy that is generally high across the range of boilers tested. The disadvantage of this approach is the requirement for a collected dataset. If the collected dataset is missing a specific boiler, the results may worsen. This hypothesis is tested in iteration 4 where datasets are purposefully removed from the collected training input. Iteration 3 shows similar results to the second iteration. This may be a result of training the classifier with the same dataset and hyperparameters. Despite promising results, the same disadvantage as iteration 2 exists. Finally, iteration 4 evaluated the ability to classify with withheld boiler datasets. The results of this iteration were poor with consistently poor results. Again, the mid-range models (Vitorond 500 and 630) had better performance relative to the others but still fails the generalization test. These tests demonstrate the limited generalization of boiler models. While limiting the applicability of any individual boiler model, this shows the significant value of the emulator to develop the necessary datasets to expand this FDD approach to future boilers.

6 Discussion and Conclusions

The application of machine learning classifiers to boiler FDD showed several consistent trends. First, a comparison of prediction accuracy between the algorithms tested showed that SVM (with C=1000 and gamma = 0.01) consistently outperformed all other classifiers across the boiler models for the specific fault classification (31 and 22 classes), and thus provides the most robust approach for the fault detection for this heating system. The exception to this was most simplistic (4-class) classification according to broad fault categories, where RF showed better results than SVM. It should be noted, however, that these results were poor compared with the 22-class SVM results. Across all tests, the prediction accuracy of DT lagged slightly behind RF, exhibiting signs of overfitting, while KNN had by far the poorest performance, showing it to be inappropriate for this type of classification. Further, only SVM used consistent hyperparameters across all top-performing models; all other algorithms had variations between the optimal hyperparameters that necessitated small changes in the algorithm coding between boilers of different sizes and manufacturers.

The three approaches to fault labeling also showed significant differences and provided insight on future work of this kind. The initial (31-class) dataset considered not only the fault type but the degree (in 5% increments) and only moderate accuracy (80%) was achieved. A closer look at the results indicated that the most significant source of error was the inability for the classifiers to distinguish between adjacent classes, most significantly for excess air. This resulted in high confounding of adjacent classes, for example 5% vs 0% (nominal) or 10% excess air, but very little confounding between more distinct classes. Similar confounding occurred for low values of waterside scaling and air-side fouling. Despite the misclassification, each classifier had exceptionally high accuracy with mid-to-high levels of fouling/scaling. This ability to distinguish between degrees of fouling and scaling is particularly valuable as this will allow building operators to track the progression of these issues and quickly identify if a problem is progressing slowly or rapidly and plan equipment maintenance in response. The ability to distinguish between various degrees of excess air is less critical, as this issue is typically not one that progresses over time.

To improve algorithm accuracy while recognizing the limited value of distinguishing between amounts of excess air, the data was relabeled to 22 classes: all distinction between fouling and scaling were retained but excess air faults were considered as a single class. This resulted in a significant increase in overall classification accuracy: SVM increased to an average of 92% prediction accuracy from 80.3% and DT and RF increased from 61% to 84.4% and 58.5% to 86.2%, respectively. Even KNN, which had an accuracy below 10% initially increased to 46.5%. Once again, the hyperparameters of SVM were constant across all boiler models, while the others changed slightly between boiler sizes and manufacturers.

The final modification sought to eliminate the misclassification within boiler classes by assembling the range of faults as a singular class, resulting in a simple 4-class dataset. This resulted in reasonably consistent results in RF and DT prediction accuracy compared with the 22-class labels, but the accuracy of SVM suffered significantly. This approach was deemed to be the least useful of all, both due to the only moderate accuracy of the best classifier (SVM at 85%) in conjunction with the inability to track fault progression over time. Overall, the 22-class approach was found to be the most effective to support an intelligent boiler monitoring system for integration into the

building automation system. This will provide operators with a previously unavailable degree of insight into boiler fault progression, allowing for improved maintenance schedules and permitting the optimization of operational costs.

This research had also explored the possibility to generalize boiler performance. The goal of generalizing boiler performance includes achieving high levels of classification accuracy despite missing or new data. Four studies were performed as metrics for generalizability of the boiler datasets. However, the results were generally poor across all the studies that relied on the machine learning algorithm to infer boiler performance. The classifier was unable to provide results with high classification accuracy because the trained model was incapable of generalizing the performance across nominal or faulty performance. Therefore, this highlights the importance of the boiler emulator within the proposed FDD strategy to provide accurate classification results.

The development of this FDD tool presents promising results, although there are several limitations of this research as presented. Firstly, the classification is only performed for individual faults, not combined/hybrid faults. Second, this research presents only simulated fault results and manufacturer-provided nominal data; the inclusion of field-collected data would both serve to validate the fault results (where such field data is available) and extend the database with more complex real-world conditions. Addressing the first limitation, multiple concurrent faults will be simulated to permit more complex investigations to be undertaken. To address the second limitation, the authors are obtaining real data from in-situ boilers, which will be used to both enhance the dataset as well as further refine and validate the fault detection models, once such faults are detected and manually diagnosed. There are significant limitations to the fault data that can be collected, however. First, low-level fouling and scaling can be difficult to identify from decreased boiler performance and therefore those data points would likely be obtained by chance inspections. Second, the degree of fouling and scaling would be difficult to quantify manually and may require much longer out-of-service times than is acceptable to a facility engineer. Third, fouling and scaling cannot be permitted to progress to the levels simulated without risking catastrophic damage to the boiler and potentially other heating system elements, which would require testing to failure in a lab, rather than field, setting. For these reasons, there is value in using simulated data for FDD training to provide the full range of points not possible to obtain or simply not available from such field studies. Finally, while typical boiler control and monitoring points have been selected for use, there will be installations where some are not readily available. Feature analysis would provide insight on the most valuable points for optimal FDD performance.

Beyond the scope of this paper, additional research is underway to investigate the impact of signal noise on prediction accuracy, identify signal processing techniques to increase the robustness of the model for real-world applications and develop pre-processing algorithms for the time-series data collected from the field sites to use with the SVM classifier.

The presented work provides a novel approach for the design and evaluation of FDD algorithms used for non-condensing boilers, commonly found within legacy buildings. MATLAB/Simscape emulators were developed and validated for 14 different boiler models and used to generate fault data for training FDD classifiers. The most successful classifier used consistent hyperparameters and successfully detected fault conditions using only data accessible to standard legacy building automation systems, demonstrating significant potential for scaled deployment. By providing operators with the ability to leverage BAS data to detect and track boiler degradation or poor operating characteristics, boiler operators will be equipped to rapidly correct issues, thus maintain a high level of boiler efficiency and maximizing service life.

Acknowledgments

This research was funded by the Natural Science and Engineering Research Council (NSERC) Discovery Grant [RGPIN-2018-04105 and DGECR-2018-00395] and the Mitacs Globalink Internship Program.

References

- [1] S. Katipamula, M. R. Brambley, N. N. Bauman and R. G. Pratt, "Enhancing Building Operations through Automated Diagnostics: Field Test Results," in *Third International Conference for Enhanced Building Operations*, Berkeley, 2003.
- [2] J. Liang and R. Du, "Model-based Fault Detection and Diagnosis of HVAC systems using Support Vector Machine method," *International Journal of Refrigeration*, vol. 30, pp. 1104-1114, 2007.
- [3] S. Katipamula and M. R. Brambley, "Method for Fault Detection, Diagnostics, and Progostics for Building Systems A Review, Part I," *HVAC&R Research*, vol. 11, no. 1, pp. 3-25, 2005.
- [4] V. Venkatasubramanian, R. Rengaswamy, K. Yin and S. N. Kavuri, "A review of process fault detection and diagnosis Part I: Quantitative model-based methods," *Computers and Chemical Engineering*, vol. 27, pp. 293-311, 2003.
- [5] S. Deshmukh, S. Samouhos, L. Glicksman and L. Norford, "Fault detection in commercial building VAV AHU: A case study of an academic building," *Energy & Buildings*, vol. 201, pp. 163-173, 2019.
- [6] Y. Li and Z. O'Neill, "A critical review of fault modeling of HVAC systems in buildings," *Building Simulation*, pp. 953-975, 2018.
- [7] V. Venkatasubramanian, R. Rengaswamy and S. N. Kavuri, "A review of process fault detection and diagnosis Part II: Qualitative models and search strategies," *Computers and Chemical Engineering*, vol. 27, pp. 313-326, 2003.
- [8] V. Venkatasubramanian, R. Rengaswamy, S. N. Kavuri and K. Yin, "A review of process fault detection and diagnosis Part III: Process history based methods," *Computers and Chemical Engineering*, vol. 27, pp. 327-346, 2003.
- [9] Z. Afroz, G. Shafiullaha, T. Urmeea and G. Higgins, "Modeling techniques used in building HVAC control systems: A review," *Renewable and Sustainable Energy Reviews*, vol. 83, pp. 64-84, 2017.
- [10] A. Afram and F. Janabi-Sharifi, "Review of modeling methods for HVAC systems," *Applied Thermal Engineering*, vol. 67, no. 1-2, pp. 507-519, 2014.
- [11] R. Z. Homod, "Review on the HVAC System Modeling Types and the Shortcomings of Their Application," *Journal of Energy*, vol. 2013, p. 10 Pages, 2013.
- [12] J. Glembin, G. Rockendorf, E. Betram and J. Steinweg, "A New Easy-to-Parameterize Boiler Model for Dynamic Simulations," ASHRAE Transactions, vol. 119, pp. 270-292, 2013.
- [13] H. Satyavada and S. Baldi, "A Novel Modelling Approach for Condensing Boilers Based on Hybrid Dynamical Systems," *Machines*, vol. 4, pp. 1-10, 2016.

- [14] S. Baldi, T. L. Quang, H. Ondrej and P. Endel, "Real-time monitoring energy efficiency and performance degradation of condensing boilers," *Energy Conversion and Management*, vol. 136, pp. 329-339, 2017.
- [15] M. Haller, L. Konersmann, R. Haberl, A. Dröscher and E. Frank, "Comparison of Different Approaches for the Simulation of Boilers Using Oil, Gas, Pellets or Wood Chips," *Building Simulation*, no. Eleventh International IBPSA Conference, pp. 732-739, 2009.
- [16] ASHRAE, "19.4.4.1 Boilers," in ASHRAE Handbook: Fundamentals, Atlanta, ASHRAE, 2013.
- [17] J. Bourdouxhe, M. Grodent, J. Lebrun and C. Saavedra, "A Toolkit for Primary HVAC System Energy Calculation - Part 1: Boiler Model," ASHRAE Transactions, vol. 100, pp. 759-773, 1994.
- [18] P. Li, Y. Li, J. E. Seem, H. Qiao, X. Li and J. Winkler, "Recent advances in dynamic modeling of HVAC equipment. Part 2: Modelica-based modeling," *HVAC&R Research*, vol. 20, pp. 150-161, 2014.
- [19] Modelica Association, Modelica® a unified object-oriented language for systems modeling language specification Version 3.4, April 10, 2017.
- [20] Mathworks, SimscapeTM Reference R2019b, Natick, 2019.
- [21] W. A. Beckman, L. Broman, A. Fiksel, S. A. Klein, E. Lindberg, M. Schuler and J. Thornton, "TRNSYS The most complete solar energy system modeling and simulation software," *Renewable Energy*, vol. 5, pp. 486-488, 1994.
- [22] D. Clark, HVACSIM+ User's Guide Update NISTIR 7514, NIST, 1985.
- [23] MathWorks, "House Heating System," [Online]. Available: https://www.mathworks.com/help/physmod/hydro/examples/house-heatingsystem.html?searchHighlight=heating&s_tid=doc_srchtitle_. [Accessed 1 January 2019].
- [24] C. Lapusan, R. Balan, O. Hancu and A. Plesa, "Development of a Multi-Room Building Thermodynamic Model Using Simscape Library," *Energy Proceedia*, vol. 85, pp. 320-328, 2016.
- [25] A. Behravan, R. Obermaisser and A. Nasari, "Thermal Dynamic Modeling and Simulation of a Heating System for a Multi-Zone Office Building Equipped with Demand Controlled Ventilation Using MATLAB/Simulink," in *International Conference on Circuits, System and Simulation*, London, 2017.
- [26] A. Pavlúsová, M. Foltin and M. Ernek, Modelling of Heating Systems, Elektrotechnika, 2009.
- [27] A. Dahash, S. Mieck, F. Ochs and H. J. Krautza, "A comparative study of two simulation tools for the technical feasibility in terms of modeling district heating systems: An optimization case study," *Simulation Modelling Practice and Theory*, vol. 91, pp. 48-68, 2019.
- [28] Q. Zhou, S. Wang and Z. Ma, "A model-based fault detection and diagnosis strategy for HVAC systems," *International Journal of Energy Research*, vol. 33, pp. 903-918, 2009.

- [29] H. Cheung and J. E. Braun, "Development of Fault Models for Hybrid Fault Detection and Diagnostics Algorithm," National Renewable Energy Laboratory, Golden, 2015.
- [30] A. Afram and F. Janabi-Sharifi, "Black-box modeling of residential HVAC system and comparison of gray-box and black-box modeling methods," *Energy and Buildings*, vol. 94, pp. 121-149, 2014.
- [31] A. Beghi, R. Brignoli, L. Cecchinato, G. Menegazzo, M. Rampazzo and F. Simmini, "Data-driven Fault Detection and Diagnosis for HVAC Water Chillers," *Control Engineering Practice*, vol. 53, pp. 79-91, 2016.
- [32] J. M. Gordon and K. C. Ng, Cool Thermodynamics: The Engineering and Physics of Predictive, Diagnostic and Optimization, Cambridge International Science Publishing, 2000.
- [33] J. Saththasivam and K. C. Ng, "Predictive and Diagnostic Methods for Centrifugal Chillers," *ASHRAE Transactions*, vol. 114, pp. 282-287, 2008.
- [34] A. Afram and F. Janabi-Sharifi, "Gray-box modeling and validation of residential HVAC system for control system design," *Applied Energy*, vol. 137, pp. 134-150, 2015.
- [35] A. A. Farooq, A. Afram, N. Schulz and F. Janabi-Sharifi, "Grey-box modeling of a low pressure electric boiler for domestic hot water system," *Applied Thermal Engineering*, vol. 84, pp. 257-267, 2015.
- [36] L. M. Romeo and R. Gareta, "Neural network for evaluating boiler behaviour," *Applied Thermal Engineering*, vol. 26, no. 14-15, pp. 1530-1536, 2006.
- [37] E. Teruela, C. Cortés, L. I. Díez and I. Arauzo, "Monitoring and prediction of fouling in coalfired utility boilers using neural networks," *Chemical Engineering Science*, vol. 60, pp. 5035-5048, 2005.
- [38] L. Breiman, "Random Forests," Machine Learning, vol. 45, pp. 5-32, 2001.
- [39] L. Breiman, J. Friedman, R. A. Olshen and C. J. Stone, Classification and Regression Trees, Boca Raton: Taylor & Francis Group, 1984.
- [40] E. Fix and J. L. Hodges, "Discriminatory Analysis: Nonparametric Discrimination, Consistency Properties," USAF School of Aviation Medicine, Randolph Field, 1951.
- [41] C. Cortes and V. Vapnik, "Support-vector networks," *Machine Learning*, vol. 20, no. 3, pp. 273-297, 1995.
- [42] ANSI/AHRI, "2015 Standard 1500 for Performance Rating of Commercial Space Heating Boilers," Air Conditioning, Heating, and Refrigeration Institute, Arlington, 2014.
- [43] Viessmann, "Viessmann Vitorond 200 Technical Data Manual," October 2018. [Online]. Available: https://www.viessmann.ca/content/dam/vibrands/CA/pdfs/commercial/vitorond_200-

lg_tdm.pdf/_jcr_content/renditions/original.media_file.download_attachment.file/vitorond_200-lg_tdm.pdf.

- [44] F. P. Incropera and D. P. DeWitt, Fundamentals of Heat and Mass Transfer, John Wiley & Sons, 2002.
- [45] AHRI, "BTS 2000 Testing Standard Method to Determine Efficiency of Commercial Space Heating Boilers," Hydronics Institute Division of AHRI, New Jersey, 2007.
- [46] Pedregosa et al., "Scikit-learn: Machine Learning in Python," *Journal of Machine Learning Research*, vol. 12, pp. 2825 2830, 2011.