

# Mitigating Adversarial Effects of False Data Injection Attacks in Power Grid

Farhin Farhad Riya  
Department of Electrical Engineering  
and Computer Science  
University of Tennessee, Knoxville  
Knoxville, Tennessee 37996  
Email: friya@vols.utk.edu

Shahinul Hoque  
Department of Electrical Engineering  
and Computer Science  
University of Tennessee, Knoxville  
Knoxville, Tennessee 37996  
Email: shoque@vols.utk.edu

Jinyuan Stella Sun  
Department of Electrical Engineering and  
Computer Science  
University of Tennessee, Knoxville  
Knoxville, Tennessee 37996  
Email: jysun@vols.utk.edu

Jiangnan Li  
Department of Electrical Engineering and  
Computer Science  
University of Tennessee, Knoxville  
Knoxville, Tennessee 37996  
Email: jli103@vols.utk.edu

Hairong Qi  
Department of Electrical Engineering and  
Computer Science  
University of Tennessee, Knoxville  
Knoxville, Tennessee 37996  
Email: hqi@utk.edu

**Abstract**—Deep Neural Networks have proven to be highly accurate at a variety of tasks in recent years. The benefits of Deep Neural Networks have also been embraced in power grids to detect False Data Injection Attacks (FDIA) while conducting critical tasks like state estimation. However, the vulnerabilities of DNNs along with the distinct infrastructure of cyber-physical-system (CPS) can favor the attackers to bypass the detection mechanism. Moreover, the divergent nature of CPS engenders limitations to the conventional defense mechanisms for False Data Injection Attacks. In this paper, we propose a DNN framework with additional layer which utilizes randomization to mitigate the adversarial effect by padding the inputs. The primary advantage of our method is when deployed to a DNN model it has trivial impact on the models performance even with larger padding sizes. We demonstrate the favorable outcome of the framework through simulation using the IEEE 14-bus, 30-bus, 118-bus and 300-bus systems. Furthermore to justify the framework we select attack techniques that generate subtle adversarial examples that can bypass the detection mechanism effortlessly.

**Keywords**—deep neural networks, false data injection attack, state estimation, power grid, cyber physical system.

## I. INTRODUCTION

Power grid is a complex system that connects several electric power sources to consumers through extensive power transmission and distribution networks. For ensuring the security of the electric power infrastructure, control and management systems of the power grid are essential. The North American Electrical Reliability Council's statistics indicates that 11 blackouts have occurred as a result of abnormalities in the cyber system of supervisory control and data acquisition (SCADA) [1].

State estimate is the method of determining unknown state variables in a power system based on the meter measurement

by the control center. Through the examination of the meter measurement data and power system models, state estimation is utilized in system monitoring to accurately determine the state of the power grid. Typically, the results of the state estimation are employed in contingency analysis, which is then used to control the components of the power grid. As illustrated in Figure 1, measurement data from sensors or meters, such as bus voltage, bus power flow, branch power flow, and load profiles, are typically transmitted to a control center (SCADA). The control center then analyzes the received measurement data, estimates the states of the power system, determines possible contingencies, and sends the appropriate control signals to the Remote Terminal Units (RTUs) to ensure the reliable operation of the power system

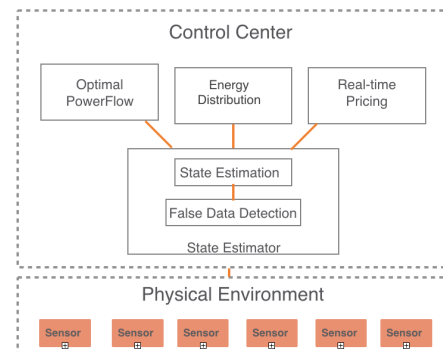


Fig. 1. Structure of communication and control system of power grids.

Cyber-Physical systems are typically complex with a variety of geographically dispersed data sources. The meters or sensors are deployed in the wild which accumulate the datas from the physical environment as depict in figure 1. Due to this distributed nature of the system it is difficult to guarantee the

security of all the meters. Moreover, the data gathered by the sensors rarely matches to the ideal theoretically calculated data because of the presence of various perturbations in the environment which causes measurement errors. Attackers could exploit this limitation by adding artfully crafted perturbations to the measurement of the compromised meters which can bypass the anomaly detection system. Numerous studies have been conducted on various False Data Injection Attack (FDIA) scenarios and some of the attacks [2][3][4] enables the attackers to generate subtle malicious false data that can bypass the detection system and make the estimator to produce incorrect output. Various critical operations like Optimal Power Flow analysis, Energy Distribution, Real-time pricing rely on the state estimation and these operations can be disturbed by the attackers through various successful false data injection attacks.

Similarly, various research has also been conducted on developing corresponding detection strategies for different attack scenarios. Among the proposed defense techniques, Machine Learning models have become the most adapted techniques in recent years for anomaly detection, specially Deep Neural Networks have demonstrated higher performance in the related research evaluation. However, the vulnerabilities of DNN models against well crafted perturbations can pose a critical issue, specially in CPS systems like power grid, as these systems have some constraints that are different from any other domains like computer vision. For state estimation, the sensors used to accumulate data from physical environment causes measurement errors and well crafted perturbations imitating these measurement errors can degrade the performance of well-trained DNN models. With this in mind our research tends to provide a framework that can increase the robustness of the DNN models and makes the attack computationally expensive for the attackers. The key contributions in this paper can be summarized as follows:

- We propose a general framework that can be easily adapted by the prevailing Machine Learning techniques which are utilized in FDIA detection.
- The vast distributive nature of CPS requires infeasible labor to guarantee the security of the sensors. We highlight that our framework does not require any specific hardware configuration or re-deployment of the sensors.
- We propose a defense method that mitigates the adversarial effect by reconstructing the input samples with multiple combination of random padding. The multi-combination padding expands the number of data samples which hinders the accuracy digression while the size of the padding increases which is crucial for test cases having less number of meters comparing
- Our proposed framework has negligible accuracy drop comparing to the vanilla models with negligible computational cost changes.
- We validate the framework through simulation using the IEEE test system, including IEEE 14-bus case, 30-bus case, 118-bus and 300-bus case. For every case the favorable outcomes justifies the proposed mechanism.

The rest of the paper is structured as follows. Section II discusses the related works done in both the attack and defenses field. Essential background information and technical

details are given in section III. A subsection of section IV discusses the approaches of finding the suitable attack strategy that better justify the defense mechanism with subtle perturbation. Moreover, section IV gives the details on the proposed framework with necessary explanation. In section V the information about the utilized dataset, model architecture and evaluation results can be found. Section IV discusses the future work and we conclude the paper in section V.

## II.

## RELATED WORKS

After 2009 when Y. Liu, et al. [5] revealed that measurements obtained from SCADA systems susceptible to malicious fake data injection (FDI) attacks, Numerous attack and defense research have been carried out to comprehend the potential of FDI attacks ever since because of the crucial role that state estimation performs in power system. A wide range of attack studies concentrate on stealthy techniques that surpass the system's residual-based bad data detectors by using their knowledge of the topological Jacobian matrix. With the understanding of the topology of the system (sparse Jacobian matrix) many attack strategies have been built, among them proposed strategies of [6], [7] and [8] have demonstrated quality evaluation results. Even without the full knowledge of the Jacobian matrix FDI attacks can still be constructed which are demonstrated in [9] [10]. The results of some attack studies like [11] have shown potential stability damage of power system. Using a static security evaluation, C. Jiongcong et al. [12] examined the effects of FDIA and concluded that FIDA can lead operators to make incorrect decisions. [13] analyzes the effects both random and structured bad data on state estimation. Data leaking and false injection attacks continue to be primary concerns for smart grid security since the stability of the grid heavily depend on the data in the grid [5].

Defending against FDI attacks various defense mechanisms are studies which protects a few carefully selected measurements [14] [15]. They provide both the optimum and the least complex algorithms for preserving the integrity of the data, and they employ physical experiments to support their claims. An adaptive cumulative sum approach was proposed by Huang et al. [15] to address the issue of quick detection of false data. Studies like [16] and [17] utilized PMU measurements which are synchronized to GPS signals.

With the increasing popularity of ML models in numerous fields, different studies are conducted in the power grid domain utilizing the advantages of ML models not only for their quality performance but also for their easy implementation. Unlike the previously mentioned defenses, using machine learning models does not require any additional hardware devices or re-deployment of the sensors. Moreover, ML models do not require to solve complex time-domain equations relating to solve power grid which make the strategies computationally efficient. Because of the mentioned advantages machine learning is one of the primary methods used to detect FDIA at the moment. In order to classify attacks, Ozay et al. [18] produce Gaussian dispersed attacks and employ both supervised and semi-supervised machine learning techniques. Similar to this, Esmalifalak et al. [19] develop an unsupervised learning case-based statistical anomaly detection and a distributed SVM based model for labeled data. [22] exploited

Recurrent Neural Networks (RNN) to detect FDIA. In order to capture the dynamic behavior of the power system, a recurrent neural network with LSTM cells is employed in [20], and a convolutional neural network [21] is utilized to balance two input sources. Several studies have been conducted using Deep Neural Networks (DNN) to defend against FDIA [23]-[25].

Though DNN models have shown extremely good results among all the ML models, they are also vulnerable to different attacks. Szegedy et al. [26] uncovered the existence of DNN adversarial scenarios in 2013. The DNNs will be manipulated to generate false results by adding a modest, purposefully-created perturbation to the inputs. There have been several proposed adversarial attack techniques, and Goodfellow et al. presented the Fast Gradient Sign Method (FGSM), which generates perturbations using signed gradient values [27]. The Fast Gradient Method developed by Rozsa et al. utilized the gradient values directly [28]. Iterative attack [29] and DeepFool [30] are two yet well adversarial attack methods. To defend those attacks several methods were proposed among them adversarial training [31], model distillation [32], adversarial detection [33] input reconstruction [34] are mostly used defense techniques.

### III. APPROACH

#### A. Overview of Generating Adversarial Examples


In this section we discuss the attacks strategies we adopted in our research to better justify our proposed framework. In this study we find the suitable attack strategy that adds subtle perturbation to the samples and generates well-crafted adversarial examples that degrades the models performance. We assume that if a model without any defense mechanism can classify any crafted sample correctly then the model is robust itself or the attack is not strong enough to fool the model. Therefore, in this section we look for the suitable attack that produces well crafted samples that makes the model generates wrong classification. Our study includes three attack strategies as follow:

**Random Perturbation:** This attack strategy considers different level of random noise intensity for generating the false data. The intensity of the noise is considered from 0 to 1. As the noise intensity is randomly selected, the false datas generated by this attack is high likely contain very large noises which makes the true and false data easily distinguishable by the detection model.

**Universal Noise:** In this attack strategy a universal noise for a certain set of data samples is selected which makes the model misclassify the highest. The universal noise is then used to create the crafted false data samples.

**Iterative Gaussian Noise:** This attack strategy follows an iterative gaussian distribution to generate the false data and it creates the most subtle noises comparing the other two mentioned attack techniques. Fig 2 shows the manifold of the true and false data samples which depicts that the samples have very close features which are not easily distinguishable and it makes the model misclassify with higher confidence.

Fig 2: Manifold of normal and false data generated by the iterative gaussian attack strategy

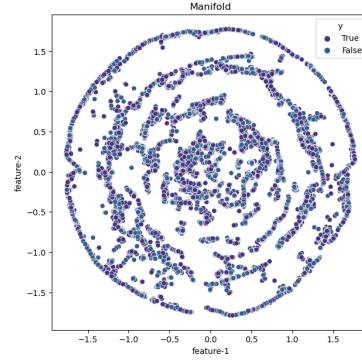

#### B. Overview of the proposed framework

In FDIAs the attackers exploit gradient-based optimization techniques to iteratively produce the perturbations. Adversarial perturbations in FDIA detection are very likely to be distinct to each sample since the perturbation produced by

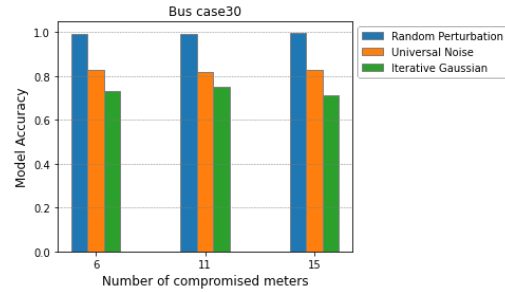


Fig 3: Model accuracy for different attack strategies while various number of meters are compromised for bus case 14

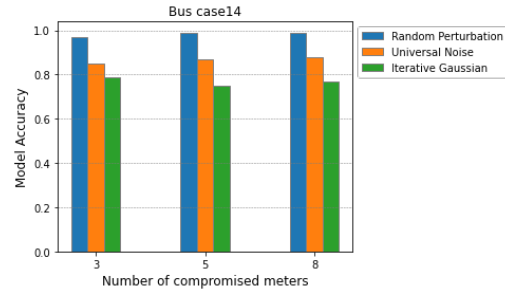


Fig 4: Model accuracy for different attack strategies while various number of meters are compromised for bus case 30

multi-step attacks typically has worse transferability. Therefore, perturbation generated for a particular sample will have less chances to work on a different sample to make the model misclassify with same higher level of confidence. We exploit this limitation and propose a framework that generates randomly padded samples that makes it computationally infeasible for an attacker to generate adversarial examples.

Inspired by the work of Jiangnan et al. [36] which introduces a framework that reconstructs the input samples with random

padding as a defense mechanism that makes it infeasible for the attackers to generate adversarial examples with multi-step iteration by guessing the random combination of a sample. Our framework follows similar construction but we redesigned the input sample reconstruction procedure which does not compromise the performance of the model while handling large number of padding sizes. Large number of padding sizes are crucial while considering cases with less number of features in each meter measurement vector.

#### IV. EXPERIMENTS

In this section, we conduct experiments with IEEE test systems, such as the IEEE 14-bus, 30-bus, 118-bus, and 300-bus systems, to validate our proposed framework.

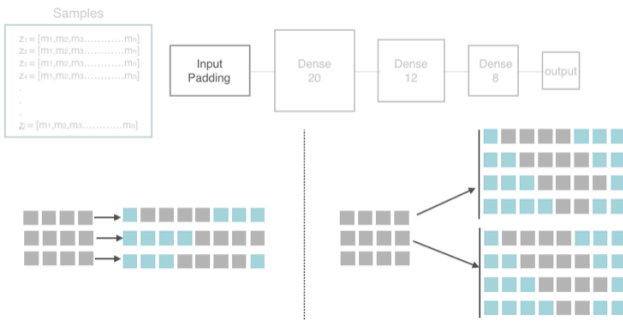


Fig 5: Overview of the framework

##### A. Dataset

For the simulation, we use a DC power flow model. We extract the configuration for the IEEE test systems out of MATPOWER, a MATLAB tool for dealing with power flow problems. [35]. Using the MATPOWER tool we construct the H matrix and then derive the meter measurements. Each measurement vector  $z$  contains the power flow measurement data of the branch and the number of measurement in each  $z$  vector is denoted as  $m$ . As we consider different IEE test systems, the value of  $m$  is different for each cases.

For obtaining the dataset for FDIA detection we generate normal data and false data representing the two classes required for the experiments as FDIA detection is a binary classification problem. Our training dataset contains 40,000 samples for all the IEEE test cases and among the samples 50% of the samples contain perturbations to poison the dataset. The normal data samples are labeled as 0 and the false data samples are labeled as 1. To justify our framework we run multiple experiments for variety test cases and for each case we consider different number of compromised meter to compare the results. According to the finding of our research if around 4% of the total meters can be compromised it can highly impact the accuracy of the detection model. Table 1 represents the different scenario we consider for evaluating our proposed work.

IEEE-test system	Value of m	Number of Compromised meters
Case14	20	3,5,8
Case30	41	6,11,15
Case118	186	12,26,35
Case300	411	18,25,40

Table 1: The number of measurements in  $m$  and the number of compromised meters for each test case scenario

##### B. Different Case System

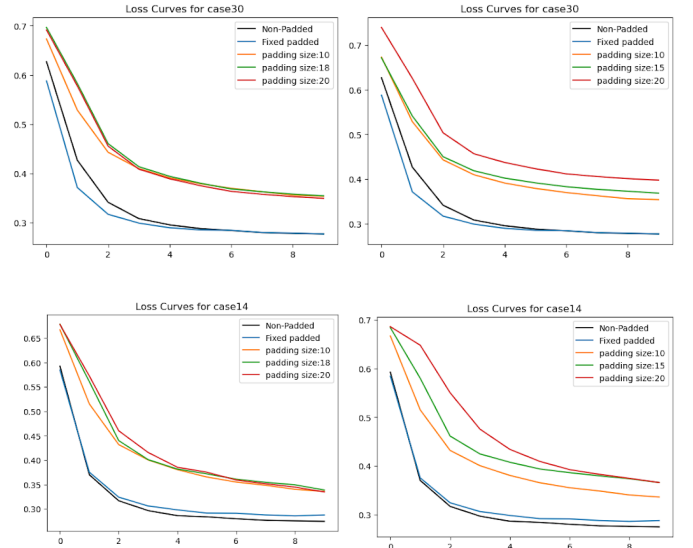


Fig 6: Loss curve for different test cases considering various padding size

#### V.

#### CONCLUSION

Adversarial attacks like FIDA poses significant threat even to the detection methods that includes DNN models and ensuring security to physical level sensors is infeasible along with highly depends on specific hardware deployment. Therefore, in this paper we study a defense mechanism that utilizes a randomization input reconstruction technique that helps to make the adversarial attacks less effective on the DNN-base FDIA detection frameworks. We evaluate our framework against non trivial attacks that causes significant accuracy digression to the models decision. Our easily

deployable framework with is compatible to any DNN model shows favorable results on different IEEE bus test systems.

## REFERENCES

1. S. Sheng, W. Yingkun, L. Yuyi, L. Yong, J. Yu, "Cyber attack impact on power system blackout," Reliability of Transmission and Distribution Networks (RTDN 2011).
2. M. A. Rahman and H. Mohsenian-Rad, "False data injection attacks with incomplete information against smart power grids," in *2012 IEEE GLOBECOM*, pp. 3153–3158, IEEE, 2012.
3. Z.-H. Yu and W.-L. Chin, "Blind false data injection attack using pca approximation method in smart grid," *IEEE Transactions on Smart Grid*, vol. 6, no. 3, pp. 1219–1226, 2015.
4. X. Liu, Z. Li, X. Liu, and Z. Li, "Masking transmission line outages via false data injection attacks," *IEEE Transactions on Information Forensics and Security*, vol. 11, no. 7, pp. 1592–1602, 2016.
5. Y. Liu, P. Ning, and M. K. Reiter, "False data injection attacks against state estimation in electric power grids," in *Proceedings of the 16th ACM conference on Computer and communications security*, pp. 21–32, 2009.
6. O. Kosut, L. Jia, R. Thomas, and L. Tong, "Malicious data attacks on the smart grid," *Smart Grid*, *IEEE Transactions on*, vol. 2, no. 4, pp. 645–658, December 2011.
7. J. Kim and L. Tong, "On topology attack of a smart grid: Undetectable attacks and countermeasures," *Selected Areas in Communications, IEEE Journal on*, vol. 31, no. 7, pp. 1294–1305, July 2013.
8. M. Ozay, I. Esnaola, F. Vural, S. Kulkarni, and H. Poor, "Sparse attack construction and state estimation in the smart grid: Centralized and distributed models," *Selected Areas in Communications, IEEE Journal on*, vol. 31, no. 7, pp. 1306–1318, July 2013.
9. M. Rahman and H. Mohsenian-Rad, "False data injection attacks with incomplete information against smart power grids," in *Global Communications Conference (GLOBECOM)*, 2012 IEEE, December 2012, pp. 3153–3158.
10. A. Srivastava, T. Morris, T. Ernster, C. Vellaithurai, S. Pan, and U. Adhikari, "Modeling cyber-physical vulnerability of the smart grid with incomplete information," *Smart Grid*, *IEEE Transactions on*, vol. 4, no. 1, pp. 235–244, March 2013.
11. J. Yan, Y. Tang, B. Tang, H. He, and Y. L. Sun, "Power grid resilience against false data injection attacks," in *Power Energy Society General Meeting, 2016 IEEE*, accepted, July 2016.
12. C. Jiongcong, G. Liang, C. Zexiang, H. Chunchao, X. Yan, L. Fengji, and Z. Junhua, "Impact analysis of false data injection attacks on power system static security assessment," *Journal of Modern Power Systems and Clean Energy*, vol. 4, no. 3, pp. 496–505, 2016.
13. A. Tajer, "Energy grid state estimation under random and structured bad data," in *Proc. IEEE Sensor Array Multichannel Signal Process. Workshop (SAM)*, A Coruna, Spain, Jun. 2014, pp. 65–68.
14. Y. Huang, H. Li, K. A. Campbell, and Z. Han, "Defending false data injection attack on smart grid network using adaptive CUSUM test," in *Proc. 45th IEEE Annu. Conf. Inf. Sci. Syst. (CISS)*, Baltimore, MD, USA, Mar. 2011, pp. 1–6.
15. S. Bi and Y. J. Zhang, "Defending mechanisms against false-data injection attacks in the power system state estimation," in *Proc. IEEE GLOBECOM Workshops (GC Wkshps)*, Houston, TX, USA, Dec. 2011, pp. 1162–1167.
16. T. T. Kim and H. V. Poor, "Strategic protection against data injection attacks on power grids," *IEEE Transactions on Smart Grid*, vol. 2, no. 2, pp. 326–333, 2011.
17. J. Chen and A. Abur, "Placement of pmus to enable bad data detection in state estimation," *IEEE Transactions on Power Systems*, vol. 21, no. 4, pp. 1608–1615, 2006.
18. M. Ozay, I. Esnaola, F. Tunay Yarman Vural, S. R. Kulkarni, and H. Vincent Poor, "Machine learning methods for attack detection in the smart grid," *IEEE Transactions on Neural Networks and Learning Systems*, 27(8):1773–1786, 2016.
19. Mohammad Esmalifalak, Lanchao Liu, Nam Nguyen, Rong Zheng, and Zhu Han, "Detecting stealthy false data injection using machine learning in smart grid," *IEEE Systems Journal*, 2014.
20. Sepp Hochreiter and Jurgen Schmidhuber, "Long short-term memory," *Neural computation*, 9(8):1735–1780, 1997.
21. A. Krizhevsky, I. Sutskever, and G. E. Hinton, "Imagenet classification with deep convolutional neural networks," in *Advances in neural information processing systems*, pages 1097–1105, 2012.
22. Q. Deng and J. Sun, "False data injection attack detection in a power grid using rnn," in *IECON 2018-44th Annual Conference of the IEEE Industrial Electronics Society*, pp. 5983–5988, IEEE, 2018.
23. A. Mohammad, Y. Chakhchoukh, A. A. Jillepalli, P. T. Tomic, D. C. de Leon, F. T. Sheldon, and B. K. Johnson, "Detecting stealthy false data injection attacks in power grids using deep learning," in *2018 14th International Wireless Communications & Mobile Computing Conference (IWCMC)*, pp. 219–225, IEEE, 2018.
24. J. JQ, H. Y, L. VO, "Online false data injection attack detection with wavelet transform and deep neural networks," *IEEE Transactions on Industrial Informatics*, 2018 Apr 10;14(7):3271-80.
25. M. AS, C. G, D. ZY, "A survey on the detection algorithms for false data injection attacks in smart grids," *IEEE Transactions on Smart Grid*, 2019 Oct 30;11(3):2218-34.
26. C. Szegedy, W. Zaremba, I. Sutskever, J. Bruna, D. Erhan, I. Goodfellow, and R. Fergus, "Intriguing properties of neural networks," *arXiv preprint arXiv:1312.6199*, 2013.
27. I. J. Goodfellow, J. Shlens, and C. Szegedy, "Explaining and harnessing adversarial examples," *arXiv preprint arXiv:1412.6572*, 2014.
28. A. Rozsa, E. M. Rudd, and T. E. Boulton, "Adversarial diversity and hard positive generation," in *Proceedings of the IEEE CVPR Workshops*, pp. 25–32, 2016.
29. A. Kurakin, I. Goodfellow, and S. Bengio, "Adversarial machine learning at scale," *arXiv preprint arXiv:1611.01236*, 2016.
30. S.-M. Moosavi-Dezfooli, A. Fawzi, and P. Frossard, "Deepfool: a simple and accurate method to fool deep neural networks," in *Proceedings of the IEEE CVPR*, pp. 2574–2582, 2016.
31. A. Kurakin, I. Goodfellow, and S. Bengio, "Adversarial machine learning at scale," *arXiv preprint arXiv:1611.01236*, 2016.
32. N. Papernot, P. McDaniel, X. Wu, S. Jha, and A. Swami, "Distillation as a defense to adversarial perturbations against deep neural networks," in *2016 IEEE Symposium on Security and Privacy (SP)*, pp. 582–597, IEEE, 2016.
33. W. Xu, D. Evans, and Y. Qi, "Feature squeezing: Detecting adversarial examples in deep neural networks," *arXiv preprint arXiv:1704.01155*, 2017.
34. S. Gu and L. Rigazio, "Towards deep neural network architectures robust to adversarial examples," *arXiv preprint arXiv:1412.5068*, 2014.
35. R. D. Zimmerman and C. E. Murillo-Sanchez, *MATPOWER, A MAT-LAB Power System Simulation Package*, <http://www.pserc.cornell.edu/matpower/manual.pdf>, September 2007.
36. L. Jiangnan, Y. Yang, J. Sun, K. Tomsovic, and H. Qi, "Towards Adversarial-Resilient Deep Neural Networks for False Data Injection Attack Detection in Power Grids," *arXiv preprint arXiv:2102.09057* (2021).