

On Net Energy Metering X: Optimal Prosumer Decisions, Social Welfare, and Cross-subsidies

Ahmed S. Alahmad, *Student Member, IEEE*, Lang Tong, *Fellow, IEEE*,

Abstract—We introduce NEM X, an inclusive retail tariff model that captures features of existing net energy metering (NEM) policies. It is shown that the optimal prosumer decision has three modes: (a) the net-consuming mode where the prosumer consumes more than its behind-the-meter distributed energy resource (DER) production when the DER production is below a predetermined lower threshold, (b) the net-producing mode where the prosumer consumes less than its DER production when the DER production is above a predetermined upper threshold, and (c) the net-zero energy mode where the prosumer’s consumption matches to its DER generation when its DER production is between the lower and upper thresholds. Both thresholds are obtained in closed-form. Next, we analyze the regulator’s rate-setting process that determines NEM X parameters such as retail/sell rates, fixed charges, and price differentials in ToU tariffs’ on and off-peak periods. A stochastic Ramsey pricing program is formulated that maximizes social welfare subject to the revenue break-even constraint for the regulated utility. Performance of NEM X policies is evaluated using real and synthetic data to illuminate impacts of NEM policy designs on social welfare, cross-subsidies of prosumers by consumers, and payback time of DER investments that affect long-run DER adoptions.

Index Terms—Net energy metering policies, behind-the-meter renewable integration, capacity-based charges, cross-subsidy, distributed energy resources, Ramsey pricing, retail electricity tariff, social marginal cost pricing, social welfare.

I. INTRODUCTION

Net energy metering (NEM), since its early realization in 1979¹, has been one of the major driving forces for the phenomenal growth of the behind-the-meter (BTM) distributed energy resources (DER) such as distributed solar from rooftop photovoltaic (PV). NEM is a class of policies under which a distribution utility customer with BTM generation resources is charged for its *net-consumption* and credited for the *net-production* injected into the grid. Herein, a customer capable of BTM generation is called a *prosumer* and one without such capabilities a *consumer*.

Early NEM policies, generally referred to as NEM 1.0, sets the rate of net-consumption in \$/kWh (a.k.a. *retail rate*) equal to the rate of compensation (a.k.a. *sell rate*) for net energy injection to the distribution grid. On the one

hand, NEM 1.0 provides strong incentives for adopting BTM distributed energy resources (DER) such as solar and storage. On the other hand, NEM 1.0 creates revenue shortfalls for the distribution utility, equivalently forcing the utility to purchase electricity from prosumers at a retail price significantly higher than the wholesale price [1]. As DER adoption grows, a regulated utility may have to increase the retail price to meet its revenue adequacy constraint. Such price increases induce even stronger incentives for additional DER adoptions. Theoretically, such a positive feedback loop may result in price instability, potentially leading to a “death spiral” scenario. See [2]–[4].

Significant concerns on *cross-subsidies* have also been raised. By realizing significant bill savings under NEM 1.0, prosumers effectively shift a part of their obligation for the grid operation costs to consumers without DER [5]. Such a cross-subsidy of prosumers by consumers raises normative questions of fairness [6], [7].

There have been considerable recent changes to NEM 1.0 by various states to address revenue loss issues for the utilities and inequity concerns of cross-subsidies between customers. Most notable are the set of new NEM policies currently implemented in California [8], Arizona [9], New York [10], among others, that differentiate the retail and sell rates and/or impose some form of fixed charges such as connection or capacity-based charges (CBC). Broadly referred to as NEM 2.0, these policy variations will likely affect prosumers’ consumption choices, consumers’ DER adoption decisions, and overall social welfare distribution that includes prosumer/consumer benefits and overall societal benefits from decarbonization. There are also active discussions of successor policies of NEM 2.0 (NEM 3.0) among DER technology vendors, regulators, and utilities [11].

With evolving NEM policies and the lack of adequate analysis and modeling tools, it is challenging to delineate the impacts of the various policy choices within the NEM tariff families. This paper aims to develop a unified treatment of the NEM policies under an inclusive tariff model and provide analytical and empirical characterizations of prosumer’s consumption behavior under NEM policies and impacts of NEM policies on social welfare, cross-subsidies, and long-run DER adoptions.

Ahmed S. Alahmed and Lang Tong ({ASA278, LT35}@cornell.edu) are with the School of Electrical and Computer Engineering, Cornell University, USA. This work was supported in part by the National Science Foundation under Grants 1932501 and 1816397

¹https://en.wikipedia.org/wiki/Net_metering

A. Related work

Extensive literature exists on NEM 1.0, focusing on engineering and economic aspects. The welfare implications and subsidies have been analyzed and empirically evaluated in [12]–[14] with emphasis on the efficiency of two-part tariffs based on uniform connection charges. The adoption dynamics of BTM DER technologies under NEM 1.0 is investigated in [15], [16], and the stability of the DER adoption processes, the potential of death spiral phenomenon, and mitigation effects of connection charges are considered in [2]–[4], [15]. The cross-subsidy issues under NEM 1.0 are considered in [7], [17].

There is growing literature on various aspects of NEM 2.0, although a systematic study is lacking. The authors in [18] analyze the impact of community solar under three different metering and billing arrangements, including some features of NEM 2.0. Their results show that NEM 1.0 and NEM 2.0 are favorable for community solar customers. Numerical studies of the economic feasibility of solar plus storage packages under different rate designs, including the sub-retail sell rate feature of NEM 2.0 are presented in [19]. A study on the currently implemented NEM 2.0 in California shows that prosumer bill-savings under NEM 2.0 are higher than the costs of service, which may lead to increases in retail rates as the DER adoption evolves [20].

Beyond NEM 2.0 policies, a recent study [11] presented several alternative rate structures, including adopting tariffs with connection, CBC, and demand charges to reduce the dependency on volumetric-based cost recovery to lower the retail rate in California. Value of DER (VDER) compensation is proposed in [21] to improve equity and cost-reflectivity.

B. Summary of results and contributions

The main contribution of this work is fourfold. First, we formulate an inclusive NEM X policy model that captures features of existing NEM policies that have been implemented or are being considered for future policy reforms. The NEM X model provides an analytical framework to evaluate and compare different implementations of NEM policies, complementing some of the existing empirical studies [3], [4], [12]–[14], [22].

Second, we obtain an analytical characterization of the optimal prosumer consumption decision under the NEM-X policy model with differentiated retail and sell rates. Specifically, we show in Theorem 1 that the optimal consumption policy for a prosumer has a two-threshold structure. When the BTM DER production is below a predetermined lower threshold, it is optimal for the prosumer to net-consume at a specific fixed level. When the DER production is above a predetermined upper threshold, it is optimal for the prosumer to net-produce by consuming at a fixed level below its DER production. When the DER production is between the two thresholds, it is optimal for the prosumer to be a net-zero energy consumer by matching its consumption with

its local DER production. Closed-form expressions of the consumption levels and production thresholds are obtained. The special structure of the prosumer’s optimal consumption policy is especially significant in the analysis of the regulator’s rate-setting decision process.

Third, because of the significant stochasticity of DER, we formulate a *stochastic Ramsey pricing problem* where parameters of NEM X are chosen to maximize overall social welfare (economic efficiency) subject to the revenue adequacy constraint that ensures regulated utility recovering its costs. In particular, social welfare is defined as the sum of consumer/prosumer surpluses and total environmental benefits. NEM-X parameters considered in this work include retail and sell rates with one or two-part structures. Flat and dynamic (e.g., ToU) pricing parameters have also been considered.

Finally, we evaluate the impacts of NEM-X parameters on social welfare, cost-shifts from prosumers to consumers, and the payback time of DER investments, which directly affects long-run DER adoption rates. Using real and synthetic data to compare different implementations of NEM-X policies, we demonstrate, in a short-run analysis, that the transition from the Californian version of NEM 1.0 to NEM 2.0 could reduce cost-shift induced cross-subsidies and increase social welfare. However, NEM 2.0 results in longer payback time for prosumers’ DER investments, which may decelerate DER adoption in the long run. Our results elucidate tensions and tradeoffs among social welfare, cross-subsidies, and payback time that directly affects the long-term growth of DERs.

Our analysis and numerical results help to gain insights into the effectiveness of various policy realizations, confirming several recent conclusions by economists in their empirical studies. For instance, our analytical characterization of the rational prosumer’s decisions shows that, with the reduced sell rates in NEM 2.0 and successor policies, the net-production mode shrinks, indicating that such policy actions incentivize prosumers toward more self-consumption rather than net-production. See discussions in Sec. III. This result is consistent with the conclusion in [23] and the empirical findings in [19]. Furthermore, the analytical characterization of the prosumer decision manifests itself to an intuitive load priority ranking list, where less important loads are consumed only when the BTM generation is abundant. See discussions in Sec. III. Our results discussion in Sec. V shows that sell-rate reductions bring the retail rate closer to the social marginal cost (SMC) rate, which in turn reduce the gap between prosumers and consumers (non-adopters) surplus, resulting in a higher social welfare, which was also speculated in [21]. We also illustrate how an SMC-based sell-rate can effectively mitigate cost-shifts from prosumers, albeit at the cost of prolonged BTM DER payback time periods, which potentially stalls DER adoption. Moreover, we show that unlike the uniform connection charges typically implemented in NEM 1.0, which disproportionately affect

low-income customers who tend also to be non-adopters (see [24]), the differentiated retail and sell rates and discriminative CBC reduce cross-subsidies without affecting non-adopters and achieve higher levels of social welfare compared to NEM 1.0. See discussions in Sec. V. The CBC performance we present, matches the growing interest of several public utility commissions (PUC), *e.g.*, New York [10], California [25], in adopting CBC.

C. Notations and nomenclature

We use boldface for vectors and matrices. Key designations of symbols are given in Table I.

TABLE I

MAJOR DESIGNATED SYMBOLS (ALPHABETICALLY ORDERED).

$\mathbf{0}, \mathbf{1}$:	vector of all zeros and ones.
$C(\cdot)$:	utility cost function.
$\chi(\cdot)$:	indicator function.
\mathbf{d}_n, \mathbf{d} :	consumption bundle in billing cycle n .
$\mathbf{d}^\pi, \mathbf{d}^\pi(r)$:	the optimal consumption bundle.
$\mathbf{d}_p^*, \mathbf{d}_c^*$:	optimal prosumer and consumer consumption.
d_i^+, d_i^-, d_i^0 :	the optimal consumptions of device i .
ΔP^π :	bill savings due to BTM DER under tariff π .
\mathcal{E} :	environmental and health benefits of BTM DER.
γ :	the fraction of the population being prosumers.
P^π :	payment schedule under tariff π .
$\pi = (\pi^+, \pi^-, \pi^0)$:	NEM X tuple (buy rate, sell rate, fixed charge).
$\pi^\omega, \pi^{smc}, \pi^e$:	wholesale, SMC, and environmental prices.
ψ_γ^π :	cost-shifts under tariff π and adoption level γ .
r_n, r :	behind-the-meter renewable in billing cycle n
d^+, d^- :	thresholds of the optimal prosumer policy
$\mathbb{R}^M, \mathbb{R}_+^M$:	sets of M dim. real and positive real vectors.
S^π, S^+, S^- :	prosumer surpluses under π, π^+ , and π^- .
S_c^π, S_u^π :	consumers and utility surpluses under π .
t_{pb}^π :	DER payback time under tariff π .
$U(\cdot), U_i(\cdot)$:	utility functions
$V(\cdot), V_i(\cdot)$:	marginal utility functions
W_γ^π :	social welfare under tariff π and adoption level γ .
ξ :	DER installation cost.
y_n :	net energy consumption of both customer classes.
z_n, z :	net energy consumption in billing period n

II. NEM X TARIFF MODELS

We present an engineering-economic model that captures essential characteristics of various existing and proposed NEM-based tariffs and the underlying prosumer decision processes incorporated by the rate-setting regulator.

A. A multi-timescale decision model

The decision processes in distribution systems with active consumer participation involve multiple timescales. For a household equipped with a smart home energy management system, the decision process is constrained by its sensing devices that measure in a fast timescale the levels of its behind-the-meter renewables (PV) generations, environmental parameters such as temperature and humidity, and the

total consumption levels. The utility company, on the other hand, has a net-billing period (*e.g.*, hourly in California [8]) during which the *net energy* consumption (or production) that defines how the payment from (or to) the household is computed. For the regulator, it periodically reviews and evaluates the submitted rate cases and sets the retail price.

Throughout the paper, we refer to the decision process of the household EMS as the *prosumer decision process* and the rate-setting process as the *regulator's decision process*. The short-run analysis considered in this paper focuses on a single tariff setting period under which the rates are fixed.

B. NEM X tariff model

We present the NEM X tariff model where “X” stands for NEM variations (*e.g.*, NEM 1.0 and NEM 2.0) that have been implemented in practice or under consideration by the regulators. See [9], [26] for a list of NEM implementations that matches the NEM X model presented here.

Let z be the net-energy consumption in a billing period. Using the indicator function $\chi(\cdot)$, $\chi(x) = 1$ if $x \geq 0$ and $\chi(x) = 0$ otherwise, the payment from the prosumer during a billing period is given by

$$\begin{aligned} P^\pi(z) &= (\pi^+ z)\chi(z) + (\pi^- z)(1 - \chi(z)) + \pi^0 \\ &= [(\pi^+ - \pi^-)\chi(z) + \pi^-]z + \pi^0, \end{aligned} \quad (1)$$

where the NEM X parameter tuple $\pi = (\pi^+, \pi^-, \pi^0)$ is defined as follows:

- π^+ : the retail rate (a.k.a. buy rate). π^+ is the per kilowatt rate of the net consumption when $z > 0$.
- π^- : the sell rate (a.k.a. compensation rate). π^- is the per kilowatt rate for the net production when $z < 0$.
- π^0 : is the non-volumetric surcharge such as connection (delivery) charges, CBC [10], [11] or grid access charges (GAC) [11], and income-based charges [21].

By varying the billing period, one should note that the so-called Full NEM (monthly or annual billing period), and net-billing or net purchase and sale (hourly or sub hourly billing period) in [18] are simply special cases of (1).

The payment expression in (1) is further depicted in Fig.1 under different sell-rates, where a net-consumer ($z > 0$) faces the retail rate π^+ , and a net-producer faces the sell rate π^- ranging usually from the SMC rate tied to the wholesale market to the full retail rate [27]. The sell rate π^- is also referred to as value of DER, representing the value of the exported energy from prosumers to the utility.

In its full generality, NEM X tariff can be a dynamic policy, depending on the specific time of use. Specifically, let $\pi_n = (\pi_n^+, \pi_n^-, \pi_n^0)$ be the NEM-X parameter for the net consumption in the net billing period n . The payment in the n th billing period is given by (1) with π_n and net-consumption z_n .

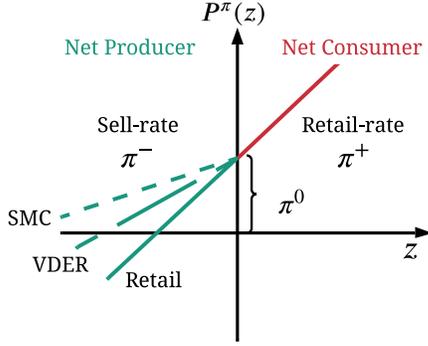


Fig. 1. NEM X tariff model in a billing period.

C. NEM 1.0, NEM 2.0, and potential successors

A discussion on a few popular retail tariffs is in order. For a more complete exposition, see [9].

1) *NEM 1.0*: The conventional net-metering tariff (NEM 1.0) has the same retail and sell rates². With $\pi_{1.0} := (\pi, \pi, \pi^0)$, the payment schedule of NEM 1.0 is given by

$$P^{\pi_{1.0}}(z) = \pi z + \pi^0,$$

where the connection charge π^0 is in the range of a few to tens of dollars. The volumetric charge π is considerably higher than the wholesale rate of electricity [21].

2) *NEM 2.0*: NEM X model (1) directly captures a key feature of NEM 2.0 that imposes different rates for net-consumption and net-production with $\pi^+ > \pi^-$. The price differential $\delta = \pi^+ - \pi^-$ ranges from a few cents/kWh to to more significant level when π^- is set at the SMC rate.

Another significant feature of some implementations of NEM 2.0 is to make the tariff parameters depend on the time of consumption/production, making it a ToU tariff that is typically defined separately by a pair of on and off peak rates, $\pi_{\text{on}} = (\pi_{\text{on}}^+, \pi_{\text{on}}^-, \pi^0)$ and $\pi_{\text{off}} = (\pi_{\text{off}}^+, \pi_{\text{off}}^-, \pi^0)$, respectively.

3) *NEM 3.0 and beyond*: NEM 2.0 can be seen as a set of transitional policies from NEM 1.0 to the more cost-reflective NEM 3.0. Four major potential directions of NEM 3.0 and successor policies are under discussion. One direction is to introduce discriminative fixed charges to prosumers based on their DER capacities or income levels [10], [11], [21]. Another direction is to implement discrimination in the volumetric charge by treating prosumers as a distinct customer class [28]. This is also captured by the model and the regulator problem in section IV, by assigning different parameter tuple for prosumers, $\pi = (\pi_p^+, \pi_p^-, \pi^0)$. Furthermore, additional sell-rate reduction is expected to be prevalent in NEM 3.0. In some states like Arizona [9], the sell-rate has already been discounted to the SMC rate

²The inclined block rate (IBR) requires a slight generalization where the payment schedule involves multiple affine segments.

($\pi^- = \pi^{\text{SMC}}$). SMC rate-based compensation is the most cost-reflective compensation policy, under which participation in additional compensation opportunities such as distribution or wholesale market services is incentivized, which realizes the FERC 2222 order goals [29]. Lastly, policy reforms can come in the form of shortening the billing period, which prolongs the payback time of DER [25]. This can be captured in our model, by solving the prosumer decision process with a timescale different from the utility's billing period.

III. OPTIMAL PROSUMER DECISION UNDER NEM X

Under NEM X, the prosumer decision process is to optimize its consumption to meet its lifestyle requirements and household scheduling constraints, given the measured (and forecasted) BTM generation and other sensor data. To avoid burdensome notations, we consider the special case when the prosumer decision process has the same timescale as that of the utility's billing period.

We begin with the standard microeconomics formulation of the household decision problem involving M consumption devices such as as in lighting, heating/cooling, and EV charging. With measurements of DER production and under NEM X tariff, the household energy management system sets the optimal l consumption bundle $\mathbf{d} \in \{(d_1, \dots, d_M) | d_i \geq 0\}$ to maximize its utility or surplus subject to a budget constraint. Specifically, we consider the following surplus maximization within a fixed billing period:

$$\begin{aligned} \mathcal{P}: \quad & \underset{\mathbf{d} \in \mathbb{R}^M}{\text{maximize}} && S^\pi(\mathbf{d}) := U(\mathbf{d}) - P^\pi(z) \\ & \text{subject to} && z = \mathbf{1}^\top \mathbf{d} - r \\ & && P^\pi(z) \leq B \\ & && \mathbf{0} \leq \mathbf{d} \leq \bar{\mathbf{d}} \end{aligned} \quad (2)$$

where $U(\cdot)$ is the utility function of the consumption bundle, $r \geq 0$ the (forecasted) BTM renewable generation, π the NEM X parameter, B the budget constraint, and $\bar{\mathbf{d}}$ the consumption limits.

The prosumer optimization in (2) is convex when the utility is concave. Given the specific form of U , the solution can be obtained analytically or numerically. When U is unknown, U and solution of (2) can be learned based on the theory of revealed preferences [30], [31] and machine learning methods.

A. Optimal prosumer decision: closed-form characterization

We now exploit the piecewise linear property of NEM X model (1) to obtain a structured solution of the prosumer optimization. To this end, we make a few simplifying assumptions on the utility function:

A1: *Additive utility*. For a household having M electric devices, the utility of the consumption bundle $\mathbf{d} \in \mathbb{R}^M$ is additive, given by

$$U(\mathbf{d}) = \sum_{i=1}^M U_i(d_i),$$

where $U_i(d_i)$ is the utility function of device i .

- A2: *Concavity.* For all i , the utility function U_i is concave, monotonically increasing, and continuously differentiable with *marginal utility* $V_i(x) = \frac{d}{dx}U_i(x)$.
- A3: The sell rate is no higher than the retail rate, $\pi^+ \geq \pi^-$.
- A4: *Non-binding constraints.* We assume the budget constraints and upper limits on \mathbf{d} are non-binding.

A1-A2 are mostly standard. The retail rate is almost always no lower than the sell rate [27], except for of the feed-in tariff policy (a.k.a. *buy-all, sell-all*) where renewable incentives are embedded in π^- . The non-binding budget constraint is acceptable when the overall electric bill is a small fraction of the disposable income of the household³.

The following theorem gives a closed-form characterization of the optimal prosumer decision and a simple computation procedure to schedule consumptions.

Theorem 1 (Prosumer decision under NEM X). *Given NEM parameter $\pi = (\pi^+, \pi^-, \pi^0)$ and marginal utility (V_1, \dots, V_M) of consumption devices, under A1-A4, the optimal prosumer consumption policy is given by two thresholds*

$$\begin{aligned} d^+ &:= \sum_i \max\{0, V_i^{-1}(\pi^+)\}, \\ d^- &:= \sum_i \max\{0, V_i^{-1}(\pi^-)\} \geq d^+ \end{aligned} \quad (3)$$

that partitions the range of DER production into three zones:

- 1) Net consumption zone: $r < d^+$. Be a net-consumer when $r < d^+$ with consumption

$$d_i^+ = \max\{0, V_i^{-1}(\pi^+)\} \geq 0, \quad \forall i. \quad (4)$$

- 2) Net production zone: $r > d^-$. Be a net-producer when $r > d^-$ with consumption

$$d_i^- = \max\{0, V_i^{-1}(\pi^-)\} \geq d_i^+, \quad \forall i. \quad (5)$$

- 3) Net-zero energy zone: $d^+ \leq r \leq d^-$. Be a net-zero consumer when $d^+ \leq r \leq d^-$ with consumption:

$$d_i^o(r) = \max\{0, V_i^{-1}(\mu^*(r))\} \in [d_i^+, d_i^-], \quad \forall i \quad (6)$$

where $\mu^*(r) \in [\pi^-, \pi^+]$ is a solution of

$$\sum_{i=1}^M \max\{0, V_i^{-1}(\mu)\} = r, \quad (7)$$

and $d_i^o(\cdot)$ is continuous and monotonically increasing in $[d_i^+, d_i^-]$.

Proof: See Appendix A.

B. Structural properties of prosumer decisions

The simple structure of the optimal consumption policy in Theorem 1 plays a significant role in our analysis. Here we highlight some of the key properties.

³It is not hard though to relax A1 and solve the optimal prosumer decision under NEM X with device-coupled utility, given some assumptions on the invertibility of the marginal utility function. The upper limit non-binding assumption in A4 can be also relaxed and incorporated in the optimal consumption decisions.

1) *The two-threshold decision policy and piece-wise linear demand:* Note that Theorem 1 shows that consumptions at all devices have the same decision zones, which implies that the total demand is a piece-wise linear function of the BTM generation r . This particular structure is particularly useful in characterizing statistical properties of prosumer behavior. Whereas the threshold decision structure is intuitive and appealing, it is not obvious that the optimal consumption (i) should have a net-zero energy mode over a range of renewables, $d^+ \leq r \leq d^-$, in which the prosumer's consumption tracks the renewable, and (ii) the optimal consumption levels are constant outside the net-zero zone. To this end, the rest of Fig. 2 explains the intuitions behind the proof of Theorem 1 for $M = 1$. The insights into the optimal schedule in the off-grid zone ($d^+ \leq r \leq d^-$) is shown in the top right of Fig. 2 that shows the prosumer surpluses $S^+(d), S^-(d)$ under π^+ and π^- , respectively defined as

$$S^+(d) := U(d) - \pi^+(d - r), \quad S^-(d) := U(d) - \pi^-(d - r),$$

with S^+ (red) being the surplus when the prosumer consumes and S^- (green) when the prosumer produces. Note that S^+ and S^- achieve their maxima at d^+ and d^- , respectively, and the two curves intersect only at $d = r$.

The prosumer's increase in aggregate consumption, when the renewable generation is abundant $r \geq d^+$, is intuitively interpreted to the fact that under a sub-retail sell rate, the surplus of selling back is devalued, incentivizing the prosumer to sell less energy back to the utility.

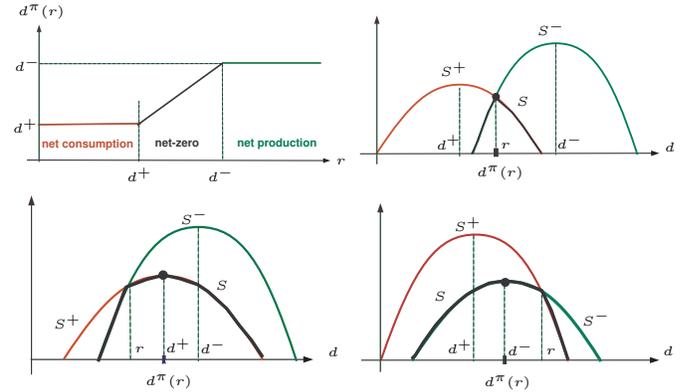


Fig. 2. Structure of optimal prosumer schedule (Note that the figure is not sketched at scale). Top-left: the optimal consumption level for device i as a function of the BTM generation r . Rest of the figures: The surpluses S^+ (red) and S^- (green) of the prosumer as functions of demand d under π^+ and π^- , respectively. The surplus function under NEM X is S (black).

2) *Priority rule for consumption allocation:* The optimal schedule given in Theorem 1 has immediate microeconomics interpretations based on the role marginal utility functions.

Fig. 3 shows the marginal utility functions of three devices and NEM prices π^+ , and π^- . Theorem 1 shows that, in

consistent with the standard consumer decision problem in microeconomics, the optimal schedule sets the consumption levels such that all devices have the same marginal utilities. Implicitly, the optimal schedule $(d_i^\pi(r))$ in (4-6) realizes a priority ranking of consumptions based on their utilities: a consumption with higher utility are scheduled at a higher quantity. Specifically, under π^+ , the consumption levels are in the reverse order of their utilities: $d_1^+ > d_2^+ > d_3^+ = 0$. Under π^- , $d_2^- > d_1^- > d_3^-$. Note that the case when the prosumer operates at the net-zero zone when $d^+ \leq r \leq d^-$ is parallel to the economic dispatch problem of generators in power system operations where a generator with lower cost is prioritized over those with higher cost.

The priority rule also determines whether the device is consumed in all three zones or not. Some devices are only consumed, when the prosumer has abundant local generation. The proposition below sheds the light on this.

Proposition 1 (Load priority ranking rule). *Given the NEM X parameter $\pi = (\pi^+, \pi^-, \pi^0)$, and marginal utility functions (V_1, \dots, V_M) , and the structure of optimal prosumer decision in Theorem 1, for any load type i , the load is consumed (or not consumed) according to V_i as per the following rules:*

- 1) If $V_i(0) > \pi^+ \geq \pi^-$, load i is consumed in all three zones.
- 2) If $\pi^+ \geq V_i(0) \geq \pi^-$, load i is not consumed in the net-consumption zone.
- 3) If $\pi^+ \geq \pi^- \geq V_i(0)$, load i is not consumed at all.

Proof: See Appendix A.

The proposition has appealing and intuitive decision behaviours. In the first case for example, when the load is consumed in the net-consumption zone, then it must be also consumed in the other zones and with higher consumption levels that are determined only by $\{\pi^+, \pi^-\}$. This is reasonable because if a device i was consumed in the net-consumption region (when local generation is scarce), then it must be also consumed, when the local generation is abundant, i.e. $r \geq d^+$. A device that is not valuable enough to be consumed in the net-consumption zone (second case), may be consumed when there is an $r \geq d^+$ local generation. If the device was not valuable enough to be consumed in the net-production zone (abundant local generation $r \geq d^-$), then it will not be consumed in any region where the local generation is lower than that threshold.

C. Comparative static analysis on NEM X

We now consider impacts of exogenous parameters such as the level of renewables and NEM X parameter π on the endogenous quantities of consumption, surpluses, and prosumer payments. The following theorem formalizes the comparative static analysis of the optimal prosumer schedule under NEM X with respect to renewable level r and price tuple π .

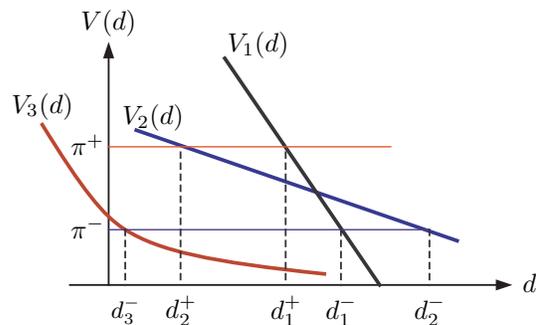


Fig. 3. Marginal utilities of three devices.

Theorem 2 (NEM X comparative static). *With respect to the renewable generation level r , the optimal consumption level $(d_i^\pi(r))$ and the prosumer surplus $S^\pi(r)$ are monotonically increasing function of r , whereas the total payment $P^\pi(r)$ is a monotonically decreasing function of r .*

With respect to the NEM X price $\pi = (\pi^+, \pi^-, \pi^0)$ for every r at the interior of each scheduling zone, as π^+ increases, the net-consumption zone is reduced, the net-zero energy zone is enlarged, and the net-production zone stays unchanged. Meanwhile, for all i , the consumption level $d_i^\pi(r)$ and the prosumer surplus $S^\pi(r)$ decrease monotonically with π^+ .

As π^- increases, the net-production zone is enlarged, the net-zero energy zone is reduced, and the net-consumption zone stays unchanged. Meanwhile, for all i , the net consumption level $d_i^\pi(r)$ and total payment decreases monotonically while prosumer surplus $S^\pi(r)$ increases monotonically with π^- .

As π^0 increases the total payment $P^\pi(r)$ increases, the prosumer surplus $S^\pi(r)$ decreases, and the prosumer consumption $d_i^\pi(r)$ stays unchanged.

Proof: See Appendix A.

Table II summarizes more details of the comparative static analysis by considering ϵ increases of the exogenous parameters and examine changes of endogenous quantities at interior points of net-consumption (+), net-production (-), and net-zero energy (0) zones.

Several observations are in order. First, under NEM X, prosumer consumption and surplus are monotonic in all scheduling zones with respect to renewable generation r and NEM X price parameters. Prosumer payment is also monotonic except in the net-consumption zone, where $\frac{\partial}{\partial \pi^+} P^\pi(r)$ may be positive or negative depending on the value of r and the characteristic of the utility function $U_i(\cdot)$.

Second, Table II gives additional insights into how a prosumer exploits behind-the-meter generations. In the net-zero energy zone, the consumer increases its consumption with r (thus its utility) without having to pay to the utility for its consumption. In both the consumption and production zones, the consumer holds the consumption level constant

while minimizing its payments to the utility. In all three cases, the prosumer avoids paying its share that covers the operating cost of the utility (when there is no behind the meter generation), which results in cost-shifts to other consumers and prosumers. See more discussions in Sec. IV.

Third, as we increase π^- to π^+ , NEM X becomes NEM 1.0. The production zone enlarges and eventually connects with the consumption zone. Because it is more profitable to sell extra power to the utility, the consumer surplus increases, the payment to the utility decreases (more precisely, the payment from the utility increases), and consumption level drops.

TABLE II
COMPARATIVE STATIC ANALYSIS

	$r \uparrow$			$\pi^+ \uparrow$			$\pi^- \uparrow$			$\pi^0 \uparrow$		
Zone	+	-	0	+	-	0	+	-	0	+	-	0
$d_i^\pi(r)$	—	—	↑	↓	—	—	—	↓	—	—	—	—
$S^\pi(r)$	↑	↑	↑	↓	—	—	—	↑	—	↓	↓	↓
$P^\pi(r)$	↓	↓	—	X	—	—	—	↓	—	↑	↑	↑

↑: increasing ↓: decreasing —: unchanged X: indeterminant

IV. NEM X RATE SETTING AND SHORT-RUN ANALYSIS

We now consider the regulator's decision process in a retail electricity market with a regulated monopoly. In such a market, the regulator sets the price of electricity subject to the constraint that the utility recovers its costs. To this end, the standard approach is the Ramsey pricing where social welfare is maximized subject to a break-even constraint [32].

A. Stochastic Ramsey Pricing under NEM X

We assume that the consumer population consists of prosumers (BTM DER adopters) and consumers (non-adopters). We make a standard assumption that, within each consumer group, the aggregated demand can be obtained by a representative customer (prosumer and consumer), respectively. Such an assumption is valid when consumer/prosumer utilities have the Gorman form [33, p. 119] and is reasonable for typical household devices. Under this assumption, the optimal consumption rule given by Theorem 1 can be used. Note, however, that the optimal consumption rule is derived based on the specific realization of the BTM DER that is more appropriately modeled as a random process. It is, therefore, necessary to develop a stochastic Ramsey pricing formulation.

Ramsey pricing maximizes social welfare. Suppose that each rate-setting cycle consists of N billing periods for which NEM X parameters are fixed. Let r_n be the random BTM DER production in the n th period. Under NEM X with

parameter π , we define social welfare W_γ^π as the sum of the expected customers (consumer and prosumer) surplus S_c^π , the expected utility surplus S_u^π , and the expected environmental and health benefits $\mathcal{E}(r_n)$ brought by the BTM DER

$$W_\gamma^\pi = \sum_{n=1}^N \mathbb{E} \left(S_c^\pi(\mathbf{d}^*(r_n), \gamma) + S_u^\pi(\mathbf{d}^*(r_n), \gamma) + \gamma \mathcal{E}(r_n) \right), \quad (8)$$

where $\gamma \in [0, 1]$ is the fraction of prosumers in the customer population, and $\mathbf{d}^*(r_n)$ is the optimal population consumption under π .

Given γ , the expected customer surplus in billing period n is given by

$$\mathbb{E}(S_c^\pi(\mathbf{d}(r_n), \gamma)) = \gamma \mathbb{E}(S^\pi(\mathbf{d}_p^*(r_n))) + (1 - \gamma) S^\pi(\mathbf{d}_c^*), \quad (9)$$

where $\mathbf{d}_p^*(r_n)$ is the optimal prosumer consumption given by Theorem 1 and \mathbf{d}_c^* the optimal consumption of consumers without DER, also given by Theorem 1 with $r_n = 0$.

Likewise, the expected utility surplus in the billing period n is given by

$$\mathbb{E}(S_u^\pi(\mathbf{d}^*(r_n), \gamma)) = \gamma \mathbb{E}(P^\pi(\mathbf{1}^\top \mathbf{d}_p^*(r_n) - r_n)) + (1 - \gamma) P^\pi(\mathbf{1}^\top \mathbf{d}_c^*) - C(y_n(r_n, \gamma)), \quad (10)$$

where P^π is the payment of prosumers in billing period n defined in (2), and $C(\cdot)$ is the utility's cost function to meet the total customers' net demand y_n in billing period n , defined by

$$y_n(r_n, \gamma) := \gamma(\mathbf{1}^\top \mathbf{d}_p^*(r_n) - r_n) + (1 - \gamma)\mathbf{1}^\top \mathbf{d}_c^*.$$

The expected environmental and health benefit, modeled as a linear function of total BTM generation r_n , is given by

$$\mathbb{E}(\mathcal{E}(r_n)) = \pi^e \mathbb{E}(r_n) \quad (11)$$

where π^e is the "price" by which DER is valued for promoting green alternatives and realizing clean energy goals [34].

By setting the NEM X parameters such that the utility recovers its operating costs, the Ramsey pricing is given by the following stochastic social welfare maximization:

$$\begin{aligned} & \underset{\pi}{\text{maximize}} && \sum_{n=1}^N \mathbb{E} \left(S_c^\pi(\mathbf{d}^*(r_n), \gamma) + \gamma \mathcal{E}(r_n) \right) \\ & \text{subject to} && \sum_{n=1}^N \mathbb{E}(S_u^\pi(\mathbf{d}^*(r_n), \gamma)) = 0. \end{aligned} \quad (12)$$

The special structure of the optimal consumption given in Theorem 1 makes solving the above optimization tractable when the underlying probability distribution of r_n is known. In practice, the above stochastic Ramsey pricing program can be replaced by a scenario-based optimization with representative scenarios of DER productions. Note that not all the NEM X parameters are optimized in practice.

B. Performance measures of NEM X

1) *Social Welfare*: Given NEM X parameter π , the social welfare of NEM X is given by W_γ^π in (8-11).

2) *Bill-saving, cost shift, and cross-subsidy*: The *bill-savings* $\Delta P^\pi(r_n)$ of a prosumer in the billing period n , defined by the monetary gain as a result of the prosumer's on-site generation, is given by [35]

$$\Delta P^\pi(r_n) := P^\pi(\mathbf{1}^\top \mathbf{d}_c^*) - P^\pi(\mathbf{1}^\top \mathbf{d}_p^*(r_n) - r_n). \quad (13)$$

Normally $\Delta P^\pi(r) \geq 0$, but when the DER is not generating, bill savings can be negative, if CBC is used in NEM X. Note that under the special case of NEM 1.0, the volumetric part of bill savings is simply $\pi^+ r_n$.

Under NEM X, the bill-saving of the prosumer results in partly shifting the burden of covering the operating cost to the consumers without DER. This cost shift represents a form of cross-subsidy of prosumers by consumers. A measure of such cross-subsidy is the *expected cost-shift* ψ_γ^π defined by the difference between the expected prosumer bill-saving and the utility avoided cost (for not having to procure power) because of DER generation:

$$\psi_\gamma^\pi = \sum_n \gamma \mathbb{E}(\Delta P^\pi(r_n) - \pi^{\text{SMC}} r_n), \quad (14)$$

where π^{SMC} is the social marginal cost price of electricity [21], [35].

3) *DER investment payback time and market potential*:

The economic feasibility of the BTM DER is primarily determined by the payback time of the DER investment from the achieved bill-savings under a particular NEM X policy [4], [36], [37]. Here we use the net present value (NPV) method with discounted bill-saving for the expected payback time:

$$t_{pb}^\pi(r, \xi) = \frac{\xi}{\mathbb{E}(\Delta P^\pi(r))}, \quad (15)$$

where $\mathbb{E}(\Delta P^\pi(r)) > 0$, and ξ is the DER installation cost, which may include any state rebates or investment tax credits. To account for the time value of money in the payback calculation, we utilize the time-to-net payback time expression in [38], as the following:

$$t_{pb}^\pi(r, \xi) = \min_{t^*} \left\{ t^* : \sum_{t=0}^{t^*} \left(\frac{1-\nu}{1+\zeta} \right)^t \mathbb{E}(\Delta P_t^\pi(r_t)) \geq \xi \right\}, \quad (16)$$

where $\nu, \zeta \in [0, 1)$ are the BTM DER system degradation factor and interest rate, respectively, α is the compounding rate.

The payback time expressions greatly depend on the expected bill savings. Under NEM X, decreasing π^- decreases bill savings, which prolongs the payback time. The shortest payback time is therefore achieved under NEM 1.0, where the sell-rate is at its highest level $\pi^- = \pi^+$. Under uniform two-part tariffs, in addition to the role of π^- , the lump sum connection charge reduces the breakeven retail rate in (12), which in turn prolongs the expected payback time of the BTM DER. A discriminatory two-part tariff, on the other hand, imposes a twofold effect on prosumers: 1) by extracting more of the prosumer surplus through the additional fixed fee,

2) by reducing the breakeven retail rate, which extends the payback period. Therefore, interestingly, both uniform and discriminatory two-part tariffs affect the prosumer surplus more than the consumer surplus, but the latter enables the regulator in designing a tariff that achieves a specific targeted and DER adoption sustaining payback time period without impacting consumers.

The expected payback time is a key factor in a consumer's DER adoption decision; it has a direct impact on the trajectory of long run DER adoption. The *market potential* $\rho^\pi(r, \xi)$ is a short-run forecast of future DER market share as a function of the expected payback time, assuming tariff parameters and costs over the years are fixed [37].

V. NUMERICAL RESULTS

To estimate and analyze the different NEM X tariff models and the role of utility rate structure in practical settings, a hypothetical distribution utility facing the wholesale price⁴ π^ω in California was assumed. The NEM X parameter was periodically set based on Sec. IV, which incorporated the prosumers and consumers optimal consumption decisions obtained in Sec. III.

A. Data sources and settings of numerical studies

The aggregated demand was obtained by a representative prosumer and consumer model, where the demand of each of the considered typical household devices has a Gorman form utility functions. The utility parameters of each household device were estimated from historical retail prices and consumption data (see Appendix B). To solve the prosumer problem, we adopted an average 5.1 kWDC/household PV installed capacity and the corresponding hourly production profile of solar PV⁵. In setting the NEM X parameters, we estimated the utility fixed costs θ which is part of $C(\cdot)$ in (11) using publicly available revenue, MWh sales, and number of customers data of Pacific Gas and Electric Company (PG&E)⁶. The estimated average daily fixed cost to serve a single residential customer was $\theta_{PGE} = \$2.86/\text{day}$. The SMC rate was assumed to be the sum of π^ω and the non-market cost of pollution that was reflected on the retail price [21]⁷. To compute (11), the price π^e was quantified at \$0.035/kWh solar from [34].

⁴The day-ahead LMP data is taken from CAISO SP15 for the period June-August, 2019. The data can be found at: <http://oasis.caiso.com/mrioasis/login.do>.

⁵The solar data profile from California solar initiative is a 15-Minute interval PV data for the period June-August, which can be found at: <https://www.californiadgstats.ca.gov/downloads>.

⁶Revenue, sales, and number of customers of PG&E data was taken from EIA over the years from 2016-2019: <https://www.eia.gov/electricity/data/state/>.

⁷The non-market cost of pollution was calculated based on the avoided non-energy cost due to BTM DER, which was estimated by [39] to be \$0.012/kWh, and the renewable portfolio standard (RPS) compliance benefits estimated to be \$0.018/kWh, as mentioned in: <https://www.sce.com/regulatory/tariff-books/rates-pricing-choices/renewable-energy-credit>.

After solving the rate-setting problem (12), three performance metrics were used in performance evaluation, as discussed in Sec IV. The social welfare was directly calculated using (8). Cost-shift and payback time were calculated according to (14) and (16), respectively. We adopt a parameterized market potential function [36] to evaluate the prospect of consumer adoption of DERs in the future.

Although wide range of metering policies and tariff designs can be studied under the introduced payment model and the derived optimal consumption policy, we limit this work to investigate four NEM X policies (Table. III). The case studies are meant to gain insights into characteristics of the initial policy NEM 1.0, the current implemented policy NEM 2.0, and two NEM successor policies involving SMC-based sell rate (NEM SMC) and capacity based charge (NEM CBC). In all simulation results, an average PV system cost of $\xi = \$4500/\text{kW}$ was used⁸.

TABLE III
DESCRIPTION OF CASE STUDIES

#	Name	Tariff	Rate	Compensation (\$/kWh)	Fixed Charges	Discrimination [‡]
1	NEM 1.0	one-part	IBR*	$\pi^- = \pi^+$	–	No
2	NEM 2.0	one-part	ToU [§]	$\pi^- = \pi^+ - 0.03$	–	No
3	NEM SMC	one-part	ToU	$\pi^- = \pi^{smc}$	–	No
4	NEM CBC	two-part	ToU	$\pi^- = \pi^+ - 0.03$	10.93 [†]	Yes

* Similar to PG&E, IBR has two blocks, with a 20% higher price for above baseline usage.

[§] ToU parameters for all case studies are similar to PG&E ToU-B, i.e. 1.5 peak ratio and a 16 – 21 peak period.

[†] CBC value is expressed in \$/kWDC PV/month, and taken from [40].

[‡] We refer to the residential customers inter-class discrimination between prosumers and consumers.

B. Social welfare

We plot the percentage change in the total social welfare, the prosumers and consumers surpluses, and the retail prices as functions of the prosumer population size γ in Fig. 4. All plots are normalized to the level of the initial 0% adoption rate.

Fig. 4 (a) shows the normalized social welfare of the four studied policies. In all cases, we observed increasing social welfare until the prosumer population exceeded a certain threshold, beyond which the social welfare started to decline. NEM 1.0 (yellow) showed the earliest decline in social welfare, followed by NEM 2.0 (green). The two successors NEM CBC (red) and NEM SMC (blue) sustained the growth of social welfare at higher prosumer population levels.

The rest of Fig. 4 explains the reasons that drove the social welfare downward when the adoption rate was high. Fig. 4 (b) shows the growing retail prices as the prosumer population increased. Recall that the retail price was the solution of the Ramsey pricing optimization where the revenue adequacy

constraint was enforced. NEM 1.0 and NEM 2.0 had the more generous bill savings for prosumers, resulting in lower revenue for the utility. Note that the price increases accelerated at the higher prosumer population, indicating potentials of death spiral scenarios.

The retail rates of NEM CBC and NEM SMC increased modestly, indicating that they effectively mitigated the revenue issues of NEM policies. These two successor policies raised the revenue quite differently, however. NEM CBC imposed the capacity-based connection charges on prosumers only, which raised additional revenue directly from prosumers, effectively making prosumers pay part of the avoided operating costs. NEM SMC, on the other hand, reduced sell rate to its minimum, putting DER-exporting prosumers on an approximately equal footing as wind/solar farms participating in the wholesale electricity market. The sharper uptick of retail prices under NEM CBC at high adoption rate is due to the fact that price differential between retail and sell rates were kept the same for all adoption levels. In contrast, the gap between the two rates under NEM SMC increased with the DER adoption rate.

Fig. 4 (c-d) show the consumer (non-adopters) and prosumer surpluses, respectively, all directly affected by the increasing retail (and sell) rates in Fig. 4 (b). Because of the concavity of consumption utilities and the linearity of the consumption cost, the retail price increase dominated the consumer surpluses, resulting in the downward trend of all consumer surpluses in Fig. 4 (c). For prosumers, except under NEM SMC, the combined effects of increasing sell rate (as a result of retail rate increase) and reduced net consumption resulted in the overall increase of prosumer surplus. Because NEM SMC had a fixed sell rate at the social marginal cost, the increasing retail rate became the dominant factor that drove the prosumer surplus down.

Note that, under NEM SMC, both consumer and prosumer surpluses decreased while the total social welfare increased. Recall that the total social welfare included the social/health benefits of DER integration, which grows linearly with the prosumer population. It was this linear growth that reversed the downward trends of consumer and prosumer surpluses under SMC.

The consistent and slowly growing retail rate under NEM SMC, maintained a minimized difference between the prosumer and consumer surplus, which together with the environmental and health benefits of BTM DER yielded a higher social welfare compared to other policies. Note, however, the effect of NEM SMC in reducing the gap between the consumer and prosumer surpluses has undesirable consequence of disincentivizing DER adoption as discussed in Sec. V-D.

C. Cost-shifts from prosumers

A key motivation behind initiatives of reforming NEM policies is the cross-subsidies of the prosumer by consumers. Using the expected cost-shift (14) as a measure of cross-subsidy, we plot in Fig. 5 the level of cost-shift (\$/day)

⁸The average 2019 solar cost data for systems less than 10kW in California can be found at: <https://www.californiadgstats.ca.gov/charts/nem>.

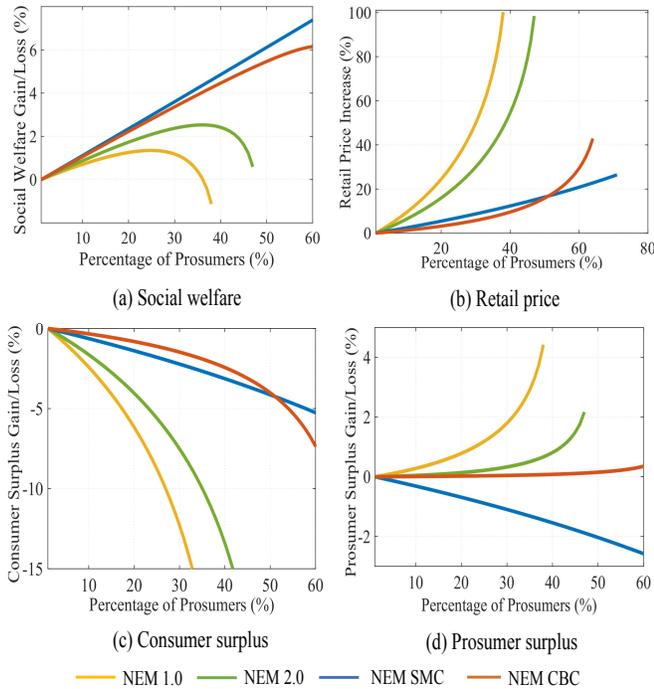


Fig. 4. Normalized social welfare and customers surpluses gain/loss.

against prosumer population (γ) under the four tariff structures. As expected, NEM 1.0 had accelerated cost-shifts (cross-subsidies) because of its high compensation rate to the prosumer. By reducing the sell rate, NEM 2.0 reduced cross-subsidies by paying a fraction of the system cost. Our simulation also showed that the current Californian NEM 2.0 (one-part TOU) tariff was more effective in reducing subsidies than the two-part tariff NEM 1.0 with up to \$11/month connection charge. Note that the fast growth of the retail rate under NEM 1.0 and NEM 2.0 (Fig. 4 (b)), resulted in an infeasible break-even condition at 38% and 47% adoption rates under NEM 1.0 and NEM 2.0, respectively.

The cost-shifts were further lowered under the two successor NEM X policies. NEM SMC, on average, yielded 92% reduction of cost-shifts compared to NEM 1.0 and 88% compared to NEM 2.0. NEM CBC was the most effective in suppressing subsidies, as it had a twofold effect on cost-shifts: a) the reduction of the retail price under the revenue adequacy condition, and b) the reduction of bill-saving through non-volumetric charge. Although NEM CBC is more robust in achieving lower subsidies during low adoption levels, NEM SMC, as shown in Fig. 5, became more effective when the retail price increased given the unbundling of retail and sell rates under this policy. NEM SMC has already been applied in some states [41], and has been proposed by many researchers as an equitable and cross-subsidy reducing compensation design [23].

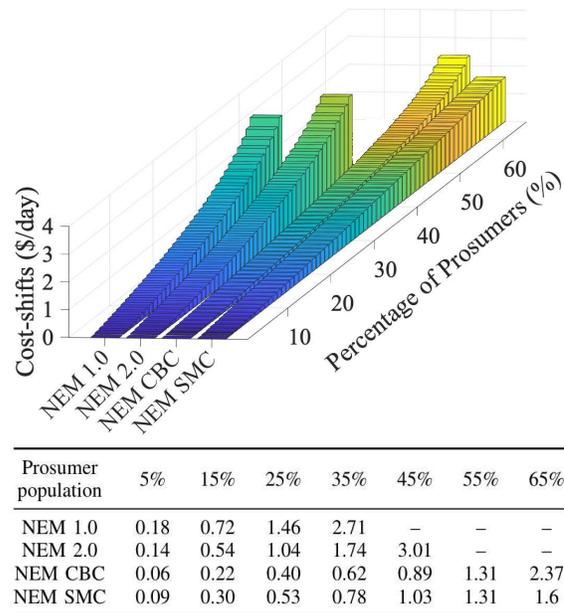


Fig. 5. Cost-shifts from prosumers.

D. Payback time and market potential

Fig. 6 shows the expected payback time and the underlying market potential for various policies. The payback time shown in Fig. 6 (a) shows that the transition in California from NEM 1.0 (yellow) to NEM 2.0 (green) prolonged the payback time by more than 45%, on average. As a result, the market potential in Fig. 6 (b) was reduced under NEM 2.0, by over than 5%.

Both NEM CBC (red) and NEM SMC (blue) greatly increased the payback time and suppressed market potentials of DER adoption, which is consistent with their more aggressive approaches in reducing surpluses from BTM DER contribution to the grid. NEM CBC had a more dramatic increase of payback time because it penalized DER adopters with heavy connection charges since it does not affect the social welfare objective. As the prosumer population increases, the revenue from CBC grew linearly and cost of system operation in the short-run analysis stayed the same. The revenue break-even condition resulted in a significant decline in payback time with increasing prosumer population size as shown in Fig. 6 (a). The underlying dynamics that caused the significant decline of CBC payback time did not exist in NEM SMC.

Although the market potential is not an accurate estimate of the actual rate of DER adoption, Fig. 6 (b) does suggest that the eventual adoption rate under NEM 2.0 would be lower than that under NEM 1.0. The effects of the two successors on market potential were more substantial. If these policies are not changed over the years, the DER penetration will remain very low.

It is important to note that the short-run analysis of payback time and market potential are inadequate in char-

acterizing the much more complex adoption dynamics where population size, tariff parameters, and technology parameters (such as PV costs) are endogenously determined. See [4].

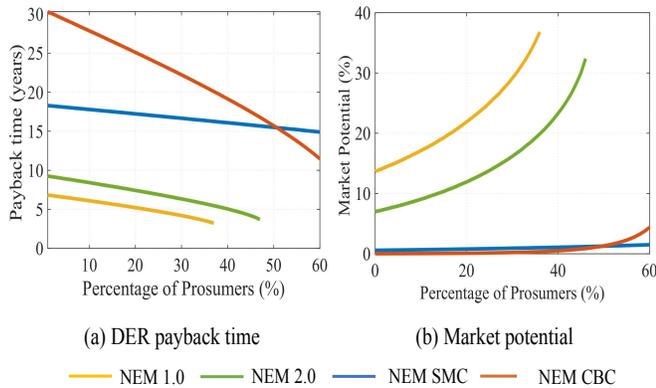


Fig. 6. System payback time and market potential⁹.

VI. CONCLUSION

NEM is the most significant pricing policy in the retail market for integrating BTM DER at scale. This work represents a first (albeit limited) attempt to establish an analytical and computation framework in analyzing and comparing NEM policy choices. While the proposed NEM X tariff model applies broadly to many rate-setting practices, the results presented here are limited in several directions. For instance, the prosumer decision model considered here does not explicitly capture inter-temporal substitutions among time periods. Among the related topics being investigated are the BTM storage resources under NEM X, for which Theorem 1 does not apply directly. Also missing is the long-run analysis of NEM X, where a dynamic rate-setting process similar to that presented in [4] needs to be considered. Although the short-run analysis presented in this paper provides valuable insights into the tensions among different policy objectives, these insights are unlikely to hold fully in the long-run analysis.

REFERENCES

- [1] S. Borenstein and J. B. Bushnell, "Do two electricity pricing wrongs make a right? cost recovery, externalities, and efficiency," National Bureau of Economic Research, Working Paper 24756, June 2018. [Online]. Available: <http://www.nber.org/papers/w24756>
- [2] D. W. Cai, S. Adlakhia, S. H. Low, P. De Martini, and K. Mani Chandy, "Impact of residential pv adoption on retail electricity rates," *Energy Policy*, vol. 62, pp. 830–843, 2013. [Online]. Available: <https://www.sciencedirect.com/science/article/pii/S0301421513006526>
- [3] N. R. Darghouth, R. H. Wiser, G. Barbose, and A. D. Mills, "Net metering and market feedback loops: Exploring the impact of retail rate design on distributed pv deployment," *Applied Energy*, vol. 162, pp. 713 – 722, 2016. [Online]. Available: <http://www.sciencedirect.com/science/article/pii/S0306261915013562>
- [4] T. Sun, L. Tong, and D. Feng, "On the dynamics of distributed energy adoption: Equilibrium, stability, and limiting capacity," *IEEE Transactions on Automatic Control*, vol. 65, no. 1, pp. 102–114, 2020.
- [5] G. L. Barbose, N. R. Darghouth, B. Hoen, and R. H. Wiser, "Income trends of residential pv adopters: An analysis of household-level income estimates," Tech. Rep., 04/2018 2018.
- [6] S. Borenstein, "Rooftop solar inequity," 06 2021. [Online]. Available: <https://energyathaas.wordpress.com/2021/06/01/rooftop-solar-inequity/>
- [7] S. Sergici, Y. Yang, M. Castaner, and A. Faruqui, "Quantifying net energy metering subsidies," *The Electricity Journal*, vol. 32, no. 8, p. 106632, 2019. [Online]. Available: <http://www.sciencedirect.com/science/article/pii/S1040619019301861>
- [8] "Net energy metering (nem)." [Online]. Available: <https://www.cpuc.ca.gov/NEM/>
- [9] *NEM State Review*, 2020, vol. 2019-182-E. [Online]. Available: <https://dms.psc.sc.gov/Attachments/Matter/cb380a19-ba7a-405b-87a6-5008b53f6ae3>
- [10] "Case 15-E-0751 – in the matter of the value of distributed energy resources," 07 2020. [Online]. Available: <http://documents.dps.ny.gov/public/MatterManagement/CaseMaster.aspx?MatterCaseNo=15-E-0751>
- [11] "Alternative Ratemaking Mechanisms for Distributed Energy Resources in California - Successor Tariff Options Compliant with AB 327," California Public Utilities Commission, Tech. Rep., 01 2021.
- [12] D. Muñoz-Álvarez, J. F. García-Franco, and L. Tong, "On the efficiency of connection charges—part ii: Integration of distributed energy resources," *IEEE Transactions on Power Systems*, vol. 33, no. 4, pp. 3834–3844, 2018.
- [13] C. Clastres, J. Percebois, O. Rebenaque, and B. Solier, "Cross subsidies across electricity network users from renewable self-consumption," *Utilities Policy*, vol. 59, p. 100925, 2019. [Online]. Available: <https://www.sciencedirect.com/science/article/pii/S0957178719300426>
- [14] S. Burger, C. Knittel, I. Perez-Arriaga, I. Schneider, and F. vom Scheidt, "The efficiency and distributional effects of alternative residential electricity rate designs," *The Energy Journal*, vol. 41, pp. 199–240, 2020. [Online]. Available: <http://www.iaee.org/en/publications/ejarticle.aspx?id=3457>
- [15] N. D. Laws, B. P. Epps, S. O. Peterson, M. S. Laser, and G. K. Wanjiru, "On the utility death spiral and the impact of utility rate structures on the adoption of residential solar photovoltaics and energy storage," *Applied Energy*, vol. 185, pp. 627–641, 2017. [Online]. Available: <https://www.sciencedirect.com/science/article/pii/S0306261916315732>
- [16] N. R. Darghouth, G. Barbose, and R. Wiser, "The impact of rate design and net metering on the bill savings from distributed pv for residential customers in california," *Energy Policy*, vol. 39, no. 9, pp. 5243 – 5253, 2011. [Online]. Available: <http://www.sciencedirect.com/science/article/pii/S0301421511004265>
- [17] A. Picciariello, C. Vergara, J. Reneses, P. Frías, and L. Söder, "Electricity distribution tariffs and distributed generation: Quantifying cross-subsidies from consumers to prosumers," *Utilities Policy*, vol. 37, pp. 23 – 33, 2015. [Online]. Available: <http://www.sciencedirect.com/science/article/pii/S0957178715300230>
- [18] P. Chakraborty, E. Baeyens, P. P. Khargonekar, K. Poolla, and P. Varaiya, "Analysis of solar energy aggregation under various billing mechanisms," *IEEE Transactions on Smart Grid*, vol. 10, no. 4, pp. 4175–4187, 2019.
- [19] N. R. Darghouth, G. L. Barbose, and A. D. Mills, "Implications of rate design for the customer-economics of behind-the-meter storage," Tech. Rep., 08/2019 2019. [Online]. Available: <https://emp.lbl.gov/webinar/implications-rate-design-customer>
- [20] "Net-energy metering 2.0 lookback study," California Public Utilities Commission, Tech. Rep., 01 2021.
- [21] S. Borenstein, M. Fowlie, and J. Sallee, "Designing Electricity Rates for An Equitable Energy Transition," Energy Institute at HAAS and Next 10, Tech. Rep., 02 2021.
- [22] A. Inzunza and C. Knittel, "Distributional effects of net metering policies and residential solar plus behind-the-meter storage adoption," Tech. Rep., 10 2020. [Online]. Available: <http://cepr.mit.edu/files/papers/2020-018.pdf>

⁹The system's degradation factor $\nu = 0.5\%$, and the currency inflation rate $\zeta = 2.4\%$ data were taken from [38]. For market potential, a 0.2 payback sensitivity and 90% market size were used as in [36].

- [23] S. Borenstein, “Can net metering reform fix the rooftop solar cost shift?” 01 2021. [Online]. Available: <https://energyathaas.wordpress.com/2021/01/25/can-net-metering-reform-fix-the-rooftop-solar-cost-shift/>
- [24] —, “The private net benefits of residential solar pv: The role of electricity tariffs, tax incentives and rebates,” National Bureau of Economic Research, Working Paper 21342, 07 2015. [Online]. Available: <http://www.nber.org/papers/w21342>
- [25] “Prepared testimony for a successor tariff to the current net energy metering tariffs,” 06 2021. [Online]. Available: <https://docs.epuc.ca.gov/PublishedDocs/SupDoc/R2008020/3765/388519135.pdf>
- [26] K. M. Smith, C. Koski, and S. Siddiki, “Regulating net metering in the united states: A landscape overview of states’ net metering policies and outcomes,” *The Electricity Journal*, vol. 34, no. 2, p. 106901, 2021. [Online]. Available: <https://www.sciencedirect.com/science/article/pii/S1040619020301937>
- [27] A. J. Lawson, *Net Metering: In Brief*. Congressional Research Service, 11 2019. [Online]. Available: <https://fas.org/sgp/crs/misc/R46010.pdf>
- [28] H. Trabish, “In new trend, utilities propose separate rate classes for solar customers without rate increase,” 11 2017. [Online]. Available: <https://www.utilitydive.com/news/in-new-trend-utilities-propose-separate-rate-classes-for-solar-customers-w/508393/>
- [29] “FERC O2222: Participation of distributed energy resource aggregations in markets operated by regional transmission organizations and independent system operators,” 09 2020. [Online]. Available: <https://www.ferc.gov/news-events/news/ferc-opens-wholesale-markets-distributed-resources-landmark-action-breaks-down>
- [30] S. N. Afriat, “The construction of a utility function from expenditure data,” *International Economic Review*, p. 67–77, 1967.
- [31] H. Varian, “Non-parametric methods in demand analysis,” *Economics Letters*, vol. 9, no. 1, pp. 23–29, 1982. [Online]. Available: <https://econpapers.repec.org/RePEc:eee:ecolec:v:9:y:1982:i:1:p:23-29>
- [32] S. J. Brown and D. S. Sibley, *The Theory of Public Utility Pricing*. Cambridge University Press, 1986.
- [33] A. Mas-Colell, M. D. Whinston, and J. R. Green, *Microeconomic Theory*, ser. OUP Catalogue. Oxford University Press, 1995, no. 9780195102680. [Online]. Available: <https://ideas.repec.org/b/oxp/obooks/9780195102680.html>
- [34] R. H. Wiser, T. Mai, D. Millstein, J. Macknick, A. Carpenter, S. Cohen, W. Cole, B. Frew, and G. A. Heath, “The environmental and public health benefits of achieving high penetrations of solar energy in the united states,” Berkeley, CA, Tech. Rep., 05 2016.
- [35] R. Borlick and L. Wood, “Net energy metering: Subsidy issues and regulatory solutions,” Tech. Rep., 09 2014. [Online]. Available: https://s3.amazonaws.com/dive_static/editorial/IEI_NEM_Subsidy_Issues_FINAL.pdf
- [36] P. Denholm, E. Drury, and R. Margolis, “Solar deployment system (solars) model: Documentation and sample results,” *National Renewable Energy Laboratory*, 09 2009.
- [37] R. W. Beck, “Distributed renewable energy operating impacts and valuation study,” *Prepared for Arizona Public Service*, 01 2009. [Online]. Available: <https://www.shorturl.at/huxA5>
- [38] E. Drury, P. Denholm, and R. Margolis, “Impact of different economic performance metrics on the perceived value of solar photovoltaics,” *National Renewable Energy Laboratory*, 10 2011. [Online]. Available: <https://www.nrel.gov/docs/fy12osti/52197.pdf>
- [39] S. Borenstein, “What can distributed generation do for the grid?” 09 2020. [Online]. Available: <https://energyathaas.wordpress.com/2020/09/28/what-can-distributed-generation-do-for-the-grid/>
- [40] “Joint Proposal of Pacific Gas and Electric Company (U 39-E), San Diego Gas & Electric Company (U 902-E) And Southern California Edison Company (U 338-E),” California Public Utilities Commission, Tech. Rep., 08 2020. [Online]. Available: https://static1.squarespace.com/static/54c1a3f9e4b04884b35cfef6/t/605120343d32dd18332462a2/1615929399865/R.20-08-020_Joint+Proposal_3.15.2021.pdf
- [41] “Net Billing– Arizona.” [Online]. Available: <https://programs.dsireusa.org/system/program/detail/3093>
- [42] C. Campaigne, M. Balandat, and L. Ratliff, “Welfare effects of dynamic electricity pricing,” 11 2016. [Online]. Available: <https://www.ocf.berkeley.edu/~clay/file/SimulatingDynamicTariffs.pdf>
- [43] A. Asadinejad, A. Rahimpour, K. Tomsovic, H. Qi, and C. fei Chen, “Evaluation of residential customer elasticity for incentive based demand response programs,” *Electric Power Systems Research*, vol. 158, pp. 26–36, 2018. [Online]. Available: <https://www.sciencedirect.com/science/article/pii/S0378779617304960>
- [44] S. Li, L. Tong, J. Xing, and Y. Zhou, “The market for electric vehicles: Indirect network effects and policy design,” *Journal of the Association of Environmental and Resource Economists*, vol. 4, no. 1, pp. 89–133, 2017. [Online]. Available: <https://doi.org/10.1086/689702>

APPENDIX A: PROOFS

A. Proof of Theorem 1

Recall the prosumer optimization under A1-A4:

$$\begin{aligned} \mathcal{P} : \quad & \underset{\mathbf{d} \in \mathbb{R}^M}{\text{minimize}} && P^\pi \left(\sum_{i=1}^M d_i - r \right) - \sum_{i=1}^M U_i(d_i) \\ & \text{subject to} && d_i \geq 0, \quad \forall i. \end{aligned} \quad (17)$$

We first break the above optimization into three convex optimizations, \mathcal{P}^+ , \mathcal{P}^- and \mathcal{P}^o , corresponding to the three scheduling zones in Theorem 1:

$$\begin{aligned} \mathcal{P}^+ : \quad & \underset{\mathbf{d} \in \mathbb{R}^M}{\text{minimize}} && \pi^+ \left(\sum_{i=1}^M d_i - r \right) - \sum_{i=1}^M U_i(d_i) \\ & \text{subject to} && d_i \geq 0, \quad \forall i, \\ & && \sum_i d_i - r \geq 0. \end{aligned} \quad (18)$$

$$\begin{aligned} \mathcal{P}^- : \quad & \underset{\mathbf{d} \in \mathbb{R}^M}{\text{minimize}} && \pi^- \left(\sum_{i=1}^M d_i - r \right) - \sum_{i=1}^M U_i(d_i) \\ & \text{subject to} && d_i \geq 0, \quad \forall i, \\ & && \sum_i d_i - r \leq 0. \end{aligned} \quad (19)$$

$$\begin{aligned} \mathcal{P}^o : \quad & \underset{\mathbf{d} \in \mathbb{R}^M}{\text{minimize}} && - \sum_{i=1}^M U_i(d_i) \\ & \text{subject to} && d_i \geq 0, \quad \forall i, \\ & && \sum_i d_i - r = 0. \end{aligned} \quad (20)$$

Given r , the optimal schedule is the one that achieves the minimum value among \mathcal{P}^+ , \mathcal{P}^- and \mathcal{P}^o .

We prove Theorem 1 with Lemma 1-2.

Lemma 1 (Schedule in the production and consumption zones). *When $r < d^+$, it is optimal to consume with schedule (d_i^+) . When $r > d^-$, it is optimal to produce with schedule (d_i^-) .*

Proof: First, we show that, if the prosumer is to consume when $r < d^+$, it is optimal to consume with (d_i^+) .

Under \mathcal{P}^+ , the Lagrangian \mathcal{L}^+ is given by

$$\mathcal{L}^+ = (\pi^+ - \mu^+) \left(\sum_{i=1}^M d_i - r \right) - \sum_i \lambda_i^+ d_i - \sum_{i=1}^M U_i(d_i),$$

where $\mu^+, \lambda_i^+ \geq 0$ are Lagrange multipliers for the inequality constraints. The KKT optimality condition gives that, for all i , the optimal schedule d_i^+ and its associated Lagrange multipliers μ^+ and (λ_i^+) must satisfy

$$V_i(d_i^+) = \pi^+ - \mu^+ - \lambda_i^+ \Rightarrow d_i^+ = V_i^{-1}(\pi^+ - \mu^+ - \lambda_i^+).$$

Because the case $\sum_i d_i^+ = r$ is covered by \mathcal{P}^o , it is without loss of generality to assume that $\sum_i d_i^+ > r$, which implies

that $\mu^+ = 0$. (This assumption is to be verified once we find d_i^+). Therefore,

$$d_i^+ = \begin{cases} V_i^{-1}(\pi^+) & d_i > 0 \\ 0 & \text{otherwise} \end{cases} = \max\{0, V_i^{-1}(\pi^+)\}.$$

With the above optimal schedule, we verify that, whenever $r < d^+$, the optimal schedule $\sum_i d_i^+ > r$, and $\mu^+ = 0$.

Next, we show that it is suboptimal to be a net-producer when $r < d^+$.

As a net-producer, the prosumer's schedule is determined by \mathcal{P}^- . The Lagrangian of \mathcal{P}^- is given by

$$\mathcal{L}^- = (\pi^- + \mu^-) \left(\sum_{i=1}^M d_i - r \right) - \sum_i \lambda_i^- d_i - \sum_{i=1}^M U_i(d_i),$$

where $\mu^-, \lambda_i^- \geq 0$ are Lagrange multipliers for the inequality constraints. The KKT condition requires that the optimal schedule d_i^- and associated Lagrange multipliers $\mu^-, \lambda_i^- \geq 0$ must satisfy

$$V_i(d_i^-) = \pi^- + \mu^- - \lambda_i^-. \quad (21)$$

If the prosumer is a net-energy producer, then $\mu^- = 0$, and $d_i^- = \max\{0, V_i^{-1}(\pi^-)\}$. Therefore, we have

$$\sum_i d_i^- - r < 0 \Rightarrow r > \sum_i d_i^- = d^- > d^+,$$

which is a contradiction to $r < d^+$.

Finally, the statement that it is optimal for the prosumer to be a net-producer with (d_i^-) when $r > d^-$ is similarly proved. ■

Lemma 2 (Schedule in the net-zero zone). *When $d^+ \leq r \leq d^-$, it is optimal to match the consumption to r with schedule $(d_i^o(r))$ where $d_i^o(r)$ is continuous and monotonically increasing function of r in $[d^+, d^-]$.*

Proof: First, we show that, if the prosumer is to be a zero net energy consumer, it is optimal to schedule with (d_i^o) .

Under \mathcal{P}^o , the Lagrangian is given by

$$\mathcal{L}^o = \mu^o \left(\sum_{i=1}^M d_i - r \right) - \sum_i \lambda_i^o d_i - \sum_{i=1}^M U_i(d_i), \quad \lambda_i^o \geq 0.$$

By the KKT condition, the optimal schedule d_i^o and the associated Lagrange multipliers μ^o and λ_i^o must satisfy

$$V_i(d_i^o) = \mu^o - \lambda_i^o.$$

Solving the above equation, we have

$$\begin{aligned} d_i^o &= V_i^{-1}(\mu^o - \lambda_i^o) \\ &= \begin{cases} V_i^{-1}(\mu^o) & d_i^o > 0 \\ 0 & \text{otherwise} \end{cases} \\ &= \max\{0, V_i^{-1}(\mu^o)\}, \end{aligned} \quad (22)$$

where μ^o must be such that the equality constraint holds:

$$\sum_{i=1}^M \max\{0, V_i^{-1}(\mu^o)\} = r. \quad (23)$$

Next we show that (23) must have a positive solution when $d^+ \leq r \leq d^-$, let

$$F(x) := \sum_{i=1}^M \max\{0, V_i^{-1}(x)\} - r.$$

Note that $F(\cdot)$ is continuous and monotonically decreasing. Because

$$F(\pi^+) \leq 0, \quad F(\pi^-) \geq 0,$$

there must exist $\mu^o \in [\pi^-, \pi^+]$ such that $F(\mu^o) = 0$. Therefore, (23) must have positive solution, which also implies that

$$d_i^+ \leq d_i^o(r) \leq d_i^-. \quad (24)$$

Furthermore, the continuity and monotonicity of F in r implies that $d_i^o(r)$ is continuous and monotonically increasing function of r .

Finally, we show that, when $d^+ \leq r \leq d^-$, it is suboptimal to net-consume or net-produce.

Consider again \mathcal{P}^+ when the prosumer is to consume optimally. From the solution of \mathcal{P}^+ in (4), we have

$$\sum_i d_i^+ \geq r \Rightarrow r < \sum_i d_i^+ = d^+,$$

which is a contradiction. The case that it is suboptimal to net-produce is similarly proved. ■

B. Proof of Theorem 2

We prove Theorem 2 in two steps.

1) *Monotonicity in r :* To show the monotonicity of $(d_i^\pi(r))$, we note that the monotonicity of V_i and $\pi^+ \geq \pi^-$ imply that $d_i^- \geq d_i^+$. Within the net-zero zone, from Theorem 1, $d_i^+ \leq d_i^o(r) \leq d_i^-$. By Lemma 2, $d_i^o(r)$ is continuous and monotonically increasing in $[d_i^+, d_i^-]$. Thus $d_i^\pi(r)$ is continuous and monotonically increasing for all $r > 0$.

Next, to show that the total payment $P^\pi(\sum_i^M d_i^\pi(r) - r)$ decreases monotonically with r , we note that (i) the optimal scheduling of the prosumer is such that, as r increases, it changes from the consumption zone to the net-zero zone to the production zone; (ii) the payment from the prosumer to the utility is only positive in the production zone.

Finally, to show that the prosumer surplus $S^\pi(r)$ is monotonically increasing, we note that

$$S^\pi(r) = \sum_i U_i(d_i^\pi(r)) - P^\pi \left(\sum_i d_i^\pi(r) - r \right).$$

Because U_i is monotonically increasing with $d_i^\pi(r)$ therefore with r , and the payment is monotonically decreasing with r , the prosumer's surplus is monotonically increasing with r . ■

2) *Monotonicity in π* : Consider first the monotonicity with respect to π^+ at a fixed r . From the definition of d^+ and the monotonicity of V_i^{-1} , $d^+ \downarrow$ as $\pi^+ \uparrow$, and d^- stays unchanged.

Note that π^+ only influences $d_i^\pi(r)$ in the consumption zone defined by $r < d^+$, within which $d_r^\pi(r) = \max\{0, V_i^{-1}(\pi^+)\}$. Assumption A2 implies that $d_r^\pi(r) \downarrow$ as $\pi^+ \uparrow$. For $r = d^+$ and every $\tilde{\pi} \geq \pi^+$, $\tilde{r}^+ := \sum_i \max\{0, V_i^{-1}(\tilde{\pi})\} < d^+ = r$. Therefore, the prosumer is in the net-zero zone in which the consumption level is independent of π^+ . Therefore, $d_i^\pi(r) = d_i^o(r)$. Thus we have $d_r^\pi(r)$ is monotonically decreasing in r .

Now consider the prosumer surplus $S^\pi(r)$ for fixed r . Suppose that $r < d^+$, by the envelope theorem,

$$\begin{aligned} \frac{\partial}{\partial \pi^+}(-S^\pi(r)) &= \frac{\partial}{\partial \pi^+} \mathcal{L}^+ \\ &= \left(\sum_i d_i^\pi(r) - r \right) > 0, \end{aligned}$$

where \mathcal{L}^+ is the Lagrangian of optimization \mathcal{P}^+ . Therefore, as $\pi^+ \uparrow$, the objective of P^+ increases, and total surplus decreases. In the net-zero and production zones, $S^\pi(r)$ is not a function of π^+ ; thus $S^\pi(r)$ is unchanged with respect in the consumption zone and the size of the consumption zone.

Next, we consider the monotonicity with respect to π^- , which has influence on the endogenous variables only in the production zone. When $r > d^-$, $d_i^\pi(r) = d_i^-$. From (5), we have $d_i^\pi(r) \downarrow$ as $\pi^- \uparrow$.

For the prosumer surplus when $r > d^-$, we have

$$\begin{aligned} \frac{\partial}{\partial \pi^-}(-S^\pi(r)) &= \frac{\partial}{\partial \pi^-} \mathcal{L}^- \\ &= \left(\sum_i d_i^\pi(r) - r \right) < 0, \end{aligned}$$

where \mathcal{L}^- is the Lagrangian of optimization \mathcal{P}^- . Therefore, as $\pi^- \uparrow$, the objective of P^- decreases, and total surplus increases.

For the prosumer payment $P^\pi(r)$ when $r > d^-$, we have

$$P^\pi(r) = -\pi^-(r - \sum_i d_i^\pi(r)) \leq 0.$$

Because the consumption decreases as π^+ increases, we have $P^\pi(r) \downarrow$ (becoming more negative).

Finally, the monotonicity of π^0 is immediate from definitions. ■

C. Proof of proposition 1

We utilize the monotonicity of V_i , and the price inequality $\pi^+ \geq \pi^-$, which together imply $d_i^- \geq d_i^+$. The proof of each case is in order:

- 1) If $V_i(0) > \pi^+ \geq \pi^-$, then $d_i = \max\{0, V_i^{-1}(\pi^+)\} > 0$, $\forall d_i > 0$, therefore the load is consumed in the net-consumption zone with d_i^+ as in Theorem 1. From (24), we have $d_i^- \geq d_i^o(r) \geq d_i^+ > 0$, hence the load is consumed in all three zones.

- 2) If $\pi^+ > V_i(0) \geq \pi^-$ the load is not consumed in the net-consumption zone, because $d_i = \max\{0, V_i^{-1}(\pi^+)\} = 0$, $\forall d_i > 0$, and therefore $d_i^+ = 0$. Whereas, $d_i = \max\{0, V_i^{-1}(\pi^-)\} > 0$, $\forall d_i > 0$, therefore $d_i^- > 0$. The load will be consumed in the net-zero zone, only if $V_i(0) > \mu^*$, which is the solution of (7). If $V_i(0) \leq \mu^*$, device i is consumed only in the net-production zone.

- 3) Contrary to case 1, if $\pi^+ \geq \pi^- \geq V_i(0)$, then $d_i = \max\{0, V_i^{-1}(\pi^-)\} = 0$, $\forall d_i > 0$, that is $d_i^- = 0$. Given $d_i^- \geq d_i^o(r) \geq d_i^+$ in (24), device i is also not consumed in the net-zero and net-consumption zones.

■

APPENDIX B: UTILITY PARAMETERS SETTING

We adopt a widely-used quadratic concave utility function of the form:

$$U_i(d_i) = \alpha_i d_i - \frac{1}{2} \beta_i d_i^2, \quad (25)$$

where α_i, β_i are some utility parameters that are dynamically calibrated.

Three load types with three different utility functions of the form in (25) were considered: 1) HVAC load¹⁰, 2) EV load¹¹, 3) other household loads such as lighting and appliances¹⁰. As introduced in [42], the historical retail prices¹² and historical consumption data are used to calibrate the quadratic utility function parameters by predicating an elasticity of demand¹³. Considering that for historical data, the price differential is zero, then an interior solution of (2) yields:

$$d_i(\pi^h) = \frac{\alpha_i - \pi^h}{\beta_i},$$

where π^h is the historical retail price. For each load type i having an elasticity of demand ε_i , the elasticity can be expressed as:

$$\varepsilon_i(\pi^h) = -\frac{\partial d_i^h(\pi^h)}{\partial \pi^h} \frac{\pi^h}{d_i^h} = \frac{1}{\beta_i} \frac{\pi^h}{d_i^h} = \frac{\pi^h}{\alpha_i - \pi^h}.$$

Solving for α_i and β_i , we get:

$$\begin{aligned} \alpha_i &= -\left(\frac{1 - \varepsilon_i}{\varepsilon_i} \right) \pi^h \\ \beta_i &= -\frac{\pi^h}{\varepsilon_i d_i^h}. \end{aligned}$$

α_i and β_i are calibrated for each time period based on the realized prices and consumption data.

¹⁰ The residential load profile data is taken from NREL open dataset for a nominal household in Los Angeles. We used the summer months data, that is June-August, 2019. The data can be found at: <https://shorturl.at/cvBC1>.

¹¹ The EV load data is taken from NREL EV Infrastructure Projection (EVI-Pro) simulation tool for the city of Los Angeles, CA: <https://afdc.energy.gov/evi-pro-lite/load-profile>

¹² We use historical PG&E prices, which can be found at: <https://www.pge.com/tariffs/electric.shtml>.

¹³ The HVAC and household appliances elasticity values are taken from [43], and the EV charging elasticity value is taken from [44]