

# Defending Against Adversarial Attacks by Energy Storage Facility

Jiawei Li<sup>1</sup>, Jianxiao Wang<sup>2</sup>, Lin Chen<sup>1\*</sup>, Yang Yu<sup>1,3</sup>

1. Institute for Interdisciplinary Information Sciences, Tsinghua University, Beijing, China, 100084;

2. State Key Laboratory of Alternate Electrical Power System with Renewable Energy Sources,

North China Electric Power University, Beijing, China, 102206;

3. Shanghai Qi Zhi Institute, Shanghai, China, 200003.

**Abstract**—Adversarial attacks on data-driven algorithms applied in power system will be a new type of threat on grid security. Literature has demonstrated the adversarial attack on deep-neural network can significantly misleading the load forecast of a power system. However, it is unclear how the new type of attack impact on the operation of grid system. In this research, we manifest that the adversarial algorithm attack induces a significant cost-increase risk which will be exacerbated by the growing penetration of intermittent renewable energy. In Texas, a 5% adversarial attack can increase the total generation cost by 17% in a quarter, which account for around  $\$2 \times 10^7$ . When wind-energy penetration increases to over 40%, the 5% adversarial attack will inflate the generation cost by 23%. Our research discovers a novel approach of defending against the adversarial attack: investing on energy-storage system. All current literature focuses on developing algorithm to defending against adversarial attack. We are the first research revealing the capability of using facility in physical system to defending against the adversarial algorithm attack in a system of Internet of Thing, such as smart grid system.

**Index Terms**— Adversarial attacks, deep neural network, cyber security, energy storage, load forecast.

## I. INTRODUCTION

### A. Background and Motivation

Adversarial attacks on the algorithms in the cyber space threatens the operation of physical side in power system. The current literature in the field of deep learning manifests that the adversarial attack can fully fail a learning model by designing a negligible noise in the input data. While the smart grid is a cyber-physical system (CPS) that relies on data and learning mode, adversarial attack brings a new type of threat: attacking a physical power grid by designing noise misleading data-driven model. For instance, attacking the load-forecast model can cause more power outage by injecting a undetectable designed noise into input data. Since a load forecast bias is very common, adversarial attacks can be disguised as normal forecast bias. This unique feature differentiates the adversarial attack from the conventional physical attack. While the adversarial attack is low-cost and hard to be detected, the attack can frequently occur and lead to a large but undetectable loss.

To resist the ever-growing threat, researchers have made significant efforts, which mainly focused on potential attacks that directly affect different components of power grids' Supervisory Control And Data Acquisition (SCADA) systems. However, the power demand side, which is not controlled by SCADA, has been neglected. Meanwhile, the cyber attacks of load demand would not require the adversary to have specific knowledge of a grid's structure. Actually, operators rely on computers forecasting load demand to change the activity of generators and transmission

lines over the course of the day. A forecast bias in demand caused by an adversarial attack of electricity users could trigger a reaction by automated scheduling systems. Consequently, the accuracy of forecasted loads directly impact the cost and reliability of system operations.

Most of the current research tries to develop algorithms to defend against adversarial attack, such the generative adversarial networks (GAN) model. However, few of the existed studies notice the possibility of utilizing the physical facilities to protect a system of internet-of thing (IoT) from the algorithmic attack. While the algorithmic attack causes cost by disturbing the physical system's operation, we argue that physical facilities can play a protective role. In this research, we analyze the impact of algorithmic adversarial attack in a power grid system and discuss the possibility of using energy storage system to defending against the algorithmic attack.

### B. Related Works

Adversarial attacks has been discussed in many practical applications[1], such as computer vision[2] and natural language processing[3]. Qiu et al.[4] proposed the definition of adversarial samples. If the activation path of a sample is not included in the training activated path, then the sample is classified as an adversarial sample. There are some systematic ways to find adversarial examples or to attack the neural networks. Moosavi-Dezfooli et al.[5] presents the DeepFool algorithm, which is a simple but very useful algorithm to find the adversarial examples or to attack the neural network. Later, Madry et al.[6] uses the Projected Gradient Descent (PGD) algorithm to find adversarial examples. The algorithm runs PGD algorithm to maximize the loss, and project back to the  $\epsilon$ -ball if needed. However, the above methods are all aimed at specific scenarios, and do not involve the adversarial cyber attack of the power system. Very recent literature has notice the possible risk of adversarial attack bringing to power grid. Chen et al. found that a white-box attack can bring significant errors into the prediction of load forecast model [7].

Power systems' vulnerability to failures and attacks has been widely discussed in the past few years. Harvey malware that affects the grid control system and executes malicious commands [8] and a type of cyber attacks called *load redistribution attacks* [9] have been studied. For such load altering attacks to force the grid operator into problematic corrective actions, several methods to defend against the adversarial attacks have been proposed. In ref.[10], a cost-efficient load protection strategy was proposed. However, it may be not efficient for many distributed IoT devices. In ref.[11], the fundamental characteristics of dynamic load altering attacks are explained and a protection system is designed by formulating and solving a non-convex pole-

(Corresponding author: chen\_180707@163.com)

placement optimization problem based on a feedback from the power system frequency. In ref.[12], the vulnerability of deep neural networks (DNN) through adversarial attacks was evaluated and an adversarial-resilient DNN detection framework was designed to defend such attacks. Overall, most of the previous works are focusing on proposing the strategy and the algorithm to protect the power grid security. Little literature focuses on physical facilities to directly defend the cyber attacks.

### C. Contribution


i) To the best of our knowledge, we are a pioneering research using the facility of power grid in physical world to resist algorithmic adversarial attacks in cyber space.

ii) We found the significant and complex impacts of the adversarial attack on power grid and found the existence of extreme venerable hours. A white box attack based on projected gradient descent (PGD) algorithm is applied to simulate the user's attack behavior, where an attacker adversarially injects false data into the input features of forecasting algorithms.

iii) We highlight that the penetration of intermittent renewable energy will aggravate the impact of the adversarial attacks and exacerbate the vulnerability of power grid system.

## II. PROBLEM FORMULATION

In the actual dispatch operation of the power system, operators always make decisions for minimizing the overall cost, which will inevitably harm the interests of some users. Therefore, the user has the motivation to tamper with the data to gain more benefits. In this way, users are strategic and may mislead the model by uploading false data to obtain greater benefits. At the same time, ES can be controlled to improve the robustness of power system, as shown in Fig. 1. Thus, how adversarial users attack existing models is a problem we need to discuss below.

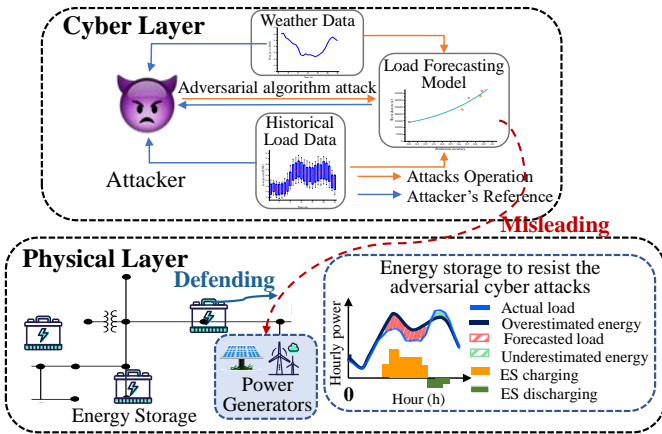

**Fig. 1. The schematic of our proposed attacks on load forecasting algorithms along with the threats over power system operations.**

In this section, we formally describe the forecasting and attacking models [7]. We simulate the user's attack behavior by white-box attack, where an attacker adversarially injects false data into the input features of forecasting algorithms.

### A. Load Forecasting Formulation

The input features of load forecasting algorithms include historical records of load, weather forecasts including

temperature, weather indicators (e.g., sunny, rainy or cloudy) and seasonal indicator variables such as weekdays/weekends and hour of the day. Due to the limitation of model size and operating speed, the historical data generally used is the data of a just passed period. Mathematically, the system operator would be able to collect a training dataset:

$$\sigma_{t+1} := \{X_i, T_i, E_i\}_{i=t-H}^t, \quad (1)$$

where,  $H$  represents the time period scale for intercepting historical data;  $X_i$  is the load demand at time  $i$ ;  $T_i$  is the temperature at time  $i$ ;  $E_i$  is the other information at time  $i$ .

In the task of load forecasting, one is interested to find a function parameterized by  $\theta$ .  $f_\theta$  is defined as a demand forecasting model, and  $\sigma_{t+1}$  is defined as the input data. Estimation of  $\theta$  is given by minimizing the difference between model predictions and ground truth values:

$$\min \sum_{t=H+1}^T L_1(f_\theta(\sigma_t), X_t), \quad (2)$$

where,  $L_1$  is the loss function to measure the performance of forecasting algorithm, which is defined by mean squared error (MSE). Here, the recurrent neural network (RNN) is used to predict the load demand.

### B. White-Box Attack

The purpose of adversarial attacks by strategic users is to widen the gap between the predicted value and the true value, thereby benefiting from it. They can control the demand  $X_i$ , but this kind of control is limited. In addition, we consider that strategic users can also control the temperature information  $T_i$  in a small range. The attacked  $\vec{X}'_t = [X'_{t-H}, \dots, X'_t]$ ,  $\vec{T}'_t = [T'_{t-H}, \dots, T'_t]$  and other information  $\vec{E}'_t = [E'_{t-H}, \dots, E'_t]$  together constitute the input data  $\sigma'_{t+1}$ . We consider the simplest goal, which is to maximize the difference between the predicted value and the true value:

$$\begin{aligned} & \max L_1(f_\theta(\sigma'_{t+1}), X_{t+1}) \\ & \text{s.t. } \|X'_i - X_i\| \leq \epsilon_1 \cdot \|X_i\| \\ & \|T'_i - T_i\| \leq \epsilon_2 \cdot \|T_i\| \\ & i = t-H, t-H+1, \dots, t \end{aligned} \quad (3)$$

where,  $\epsilon_1$  and  $\epsilon_2$  ensure small-scale control.

In this paper, we are considering white box attacks. Under the white-box setting, since the model parameters are known to the attacker, it is possible to find the attack input via solving (3). Since RNN forecasting algorithms is complex and the attacker's problem (3) is nonconvex, there is no closed-form solution for  $\vec{X}'_t$  and  $\vec{T}'_t$ . Nevertheless, an attacker can still find some attack vectors iteratively by taking gradients with respect to each time step's temperature values. For the highly nonconvex nature of the forecasting model, a slight (suboptimal) perturbation of the input features would drastically change the forecast output.

Based on (3), we define a loss function  $L$  with respect to each time step's feature  $X'_{t-i}, T'_{t-i} \ i = 0, \dots, H$ . Then the attacker iteratively takes gradients of  $L$  to find the adversarial input  $X'_{t-i}$ . Here, the PGD algorithm proposed by Madry et al. is used for white box attacks [13]. We follow a simpler method to only update the feature values based on the sign of the gradient at each iteration  $k+1$ :

$$x_{k+1} = \prod_{B_i(x)} [x_k + \alpha \cdot \text{sign}(\nabla_x L(\theta, x, y))], \quad (4)$$

where,  $x$  is historical data;  $y$  is the value to be estimated;  $\alpha$  controls the step size for updating adversarial temperature values.  $\prod B_\epsilon(x)$  means  $\epsilon$ -neighborhood projection in  $x$ . The resulting adversarial temperature vector is obtained by applying (4) a number of times.

During an attack, the adversarial information are injected into the system model to cause deviation from the normal operations.

### III. SYSTEM MODEL

In this section, we consider an electricity pool model, and ignore the transmission line constraints. In the pool model, there are two supply sources, i.e., renewable energy sources and traditional thermal plants to meet the requirements of load demand every time slot. Besides, there is ES to control the intermittent and uncertainty of green energy.

**Renewable Energy.** For the zero-fuel-cost, the renewable energy should be utilized as much as possible. There could exist time slots during which renewable energy is more than demand. Let the ratio of total excessive renewable energy vs total excessive demand, defined as  $\rho$ , which is an effective measure of the availability of excessive renewable energy that can be stored for satisfying future demands.

$$\rho = \frac{\sum_{t=1}^T [w_t - D_t]^+}{\sum_{t=1}^T [D_t - w_t]^+}, \quad (5)$$

where,  $[\cdot]^+$  is the positivity operator ( $\max\{\cdot, 0\}$ );  $w_t$  is the output of green energy at time  $t$ ;  $D_t$  is the demand at time  $t$ .

**Thermal Plant.** The unit fuel cost is assumed to be fixed. When the renewable energy output is insufficient, thermal power plants produce electricity. Since electricity power company is profit seeker, so cheaper electricity is generated first.

**Load Demand.** It should be forecasted in advance. It is used to inform system operators the future load profiles, and serves as the basis of decision-making problems. However, the load forecast will be biased after adversarial cyber attacks. When the load demand is overestimated at each time step, the operator tend to charge the excess power into the ES. If there is no surplus in ES, unfortunately the excess power can only be wasted, which will result in excess costs. When load demand is underestimated, the ES discharges to the system and the more expensive thermal plants may output power. Therefore, reasonable control of ES can help withstand such adversarial data attacks to avoid additional costs.

The renewable energy prediction and load prediction profiles are inputted into the model. However, considering the user's adversarial attack behavior on load demand, we assume that renewable energy is predicted precisely in the existing forecasting model, and the load demand is biased. Deviations in load forecasting will cause curtailment costs and additional energy cost.

The system operator may seek to minimize the expected total cost. The system model is formulated as:

$$\min C_{total} = \sum_{t=1}^T \left[ \sum_{i=1}^N c_t P_{i,t} + c_t (FD_t - D_t - g_t)^+ + c'_t (D_t - FD_t - b_t)^+ \right], \quad (6)$$

where,  $T$  is the total number of time slots;  $N$  is the number of thermal plants;  $c_t$  is the marginal cost at time  $t$ ;  $c'_t$  is the highest marginal cost among thermal plants used to satisfy

the demand at time  $t$ ;  $P_{i,t}$  is the actual power produced by thermal plant  $i$  at time  $t$ ;  $FD_t$  is the forecasted demand at time  $t$ .

subject to

$$\sum_i^N P_{i,t} + w_t = D_t + g_t - b_t, \quad (7)$$

$$B_t = B_{t-1} + g_t - b_t, \quad (8)$$

$$0 \leq B_t \leq \bar{B}, \quad (9)$$

$$B_0 = 0, \quad (10)$$

$$0 \leq P_{i,t} \leq P_{i,max}, \quad (11)$$

where,  $g_t$  and  $b_t$  are the charging and discharging power of the ES at time  $t$ , respectively;  $B_t$  is the stored energy of the ES at time  $t$ ;  $B_0$  and  $B_T$  are the initial and ultimate energy levels, respectively;  $\bar{B}$  is the capacity limitations of the ES;  $P_{i,max}$  is the capacity of thermal plant  $i$ . Since ES is expensive, the capacity  $\bar{B}$  is not large in fact. Therefore,  $\bar{B}$  is much smaller than  $D_t$ .

Constraint (7) express the power balance of the whole system. The energy balance equation and the capacity limitation of the ES are given by constraints (8) and (9), respectively. Constraint (10) ensures that the energy stored at the end of the time scope is the same as that in the initial state. Constraint (11) shows the capacity limit for the thermal plant.

**Energy Storage.** In this paper, we consider an easy control strategy of ES. When the load demand is overestimated, the ES should be controlled to store the excess power (renewable power or excess power generated for over-forecasted demand) until the ES is fully charged. In the following time, the stored electricity in ES can be discharged to make up for the lack of electricity.

---

#### Algorithm: Energy Storage Control

---

**Input:** Demand  $D_t$ , forecasted demand  $FD_t$ , renewable energy  $w_t$ , and ES status last time slot  $B_{t-1}$ .

**Output:** Cost  $C_{total}$  and ES status  $B_t$ .

**If**  $w_t < FD_t$  **then**

Discharge ES first, and then generate power by thermal plants to meet  $FD_t - w_t$  demand;

**Else**

Charge ES as much as possible until the ES cannot be charged or the ES is charged by  $w_t - FD_t$ ;

**EndIf**

**If**  $FD_t > D_t$  **then**

Charge ES as much as possible and the rest power is wasted.

**Else**

Utilize the rest renewable energy first, and then discharge ES as much as possible. If the demand is still not satisfied, use thermal power plants to meet it.

**EndIf**

Calculate  $C_{total}$  and  $B_t$  from the decision;

**return**  $C_{total}$  and  $B_t$ .

---

### IV. CASE STUDIES

To evaluate the impact of adversarial attacks on the power system, we obtain the demand, renewable and thermal plant data from electric reliability council of Texas (ERCOT)<sup>[14]</sup>. To maintain the same order of magnitude, we multiply the

original solar data by a coefficient 16000. And then we multiply wind and solar energy by coefficients 3, 4, 5, 6.5 to reflect different proportions of net renewable energy, i.e., 0.25%, 3.2%, 12% and 43%. Weather data<sup>[15]</sup> includes hourly temperature, precipitation, air density and cloud cover in Houston in 2012. The maximum demand exceeds 80000 MW per hour. The battery capacity is 16000 MW.

### A. Adversarial attacks' performance

We compare the operation cost with and without adversarial attacks on the electricity pool model. We found that the adversarial attack can largely inflate the generation cost. For instance, a 5% attack on load forecast model can increase the quarter generation cost by 200 million dollars, which is roughly 17% of the total generation cost.

In order to analyze the cost impact of adversarial attack in each hour. We define the concept of cost loss ratio in each hour. The cost loss ratio caused by an attack indicates the ratio of the difference between the cost of an attack ( $\epsilon=3\%$ ) and the cost of no attack to the average cost per hour. The attacks will bring cost losses in general, but some hours will also bring cost gains, as shown in Fig. 2. The cost loss ratio of most hours is near 0, while the cost loss ratio of some hours is greater than 0 or even less than 0. We notice that the distribution of adversarial attack's hourly impact is bimodal. Therefore, the power-system cost is extremely vulnerable in some hours shown as in Fig. 2. Thus, the hours are divided into three types: benefit hours (the cost loss ratio is lower than zero), loss hours (the cost loss ratio is higher than zero) and extremely vulnerable hours.

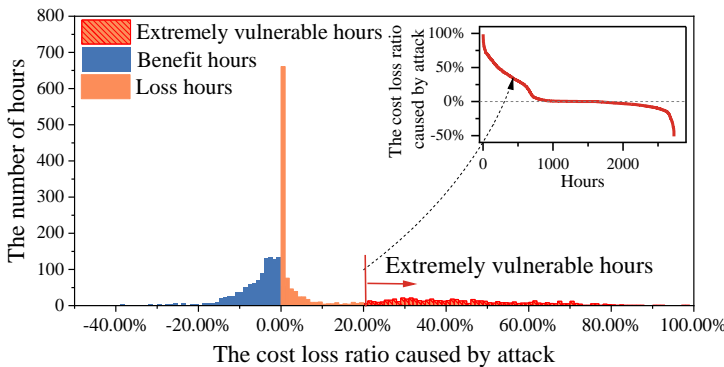


Fig. 2. The cost loss ratio caused by attack under 3.2% proportion of renewable energy.

We analyze the distribution characteristics of the three types of hours and summarize in Fig. 3(a). We found that the benefit hours are mainly distributed in 7:00-8:00 from September to December, and the loss hours are distributed from 9:00 to 22:00 in September and October. Among them, the extremely vulnerable hours are concentrated in the daily peak of electricity consumption (11:00 to 19:00). This is because electricity consumption in peak hours is large and the electricity price is higher, which is more vulnerable to user attacks. While in November and December, the loss hours appear more disorderly, and even on a certain day in December, the whole day is extremely vulnerable hours, which relates to the high electricity consumption on that day. Therefore, the system operator of ERCOT has to particularly be careful in those extremely vulnerable hours.

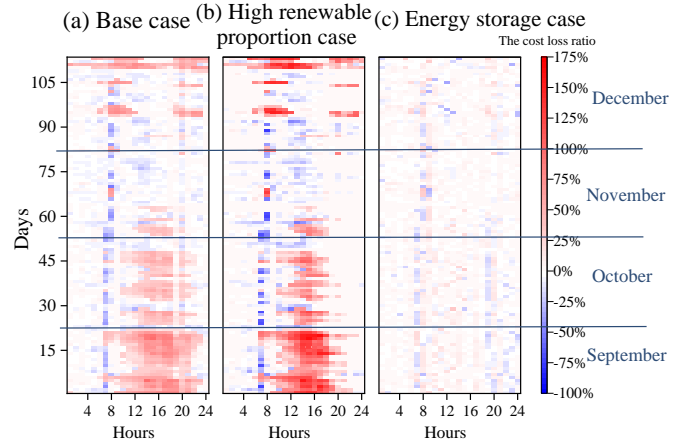


Fig. 3. A heat map of the cost loss ratio over a 24-hour period from September to December in 2012. (a) Base case under an attack ( $\epsilon=3\%$ ) with 3.2% renewable proportion. (b) High renewable proportion case under an attack ( $\epsilon=3\%$ ) with 43% renewable proportion. (c) Energy storage case to control battery to resist attacks ( $\epsilon=3\%$ ) with 3.2% renewable proportion.

### B. The impact of renewable energy

By comparing Fig. 3(a) and Fig. 3(b), it can be seen that increasing the proportion of renewable energy will not affect the distribution of the three types of hours, but will increase the cost benefit of the benefit hours and the cost loss of the loss hour, respectively. The increase in the proportion of renewable energy makes the system more vulnerable to adversarial attacks, but the impact varies from hour to hour. To further explore the impact of the proportion of renewable energy on the cost loss ratio, we performed scatter plots to the cost loss ratio under different renewable energy proportions in the same hour.


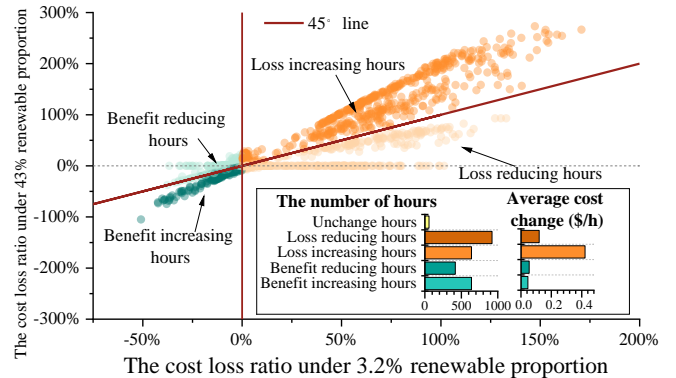


Fig. 4. For the same hours, the cost loss ratio (between no attack and  $\epsilon=3\%$  attack) under 3.2% renewable proportion is related to that under 43% renewable proportion. The equation next to the line represents the fitting function. In the lower right corner, 43% renewable proportion comparing to 3.2%, *unchange* means that the cost loss ratio remains unchanged; *increasing* means the hours with increasing cost loss ratio; *reducing* indicates the hours with decreasing cost loss ratio.

As shown in Fig. 4, with the increase in the proportion of renewable energy, the change costs in the benefit hours are small, while the change costs in the loss hours large. For the benefit hours, their reducing and increasing change no much. While for the loss hours, their cost loss ratios increase the most, and the average change cost reached 0.422\$/h, which indicates the proportion of renewable energy has a greater impact on loss hours.

### C. Energy storage to resist adversarial attacks

To evaluate the ES's ability to resist attacks, we selected the two periods (1-500 and 1500-2000 hours) to demonstrate charging and discharging conditions of the ES in the face of the attack, as shown in Fig. 5 (a) and (b). In 1-500 hours, the prediction error caused by the attack is alternately positive and negative, while most of the prediction errors in 1500-2000 hours are negative. In the case of alternating positive and negative errors, ES can be utilized to the maximum and the value of ES can be revealed to the greatest extent, as shown in Fig. 5 (c).

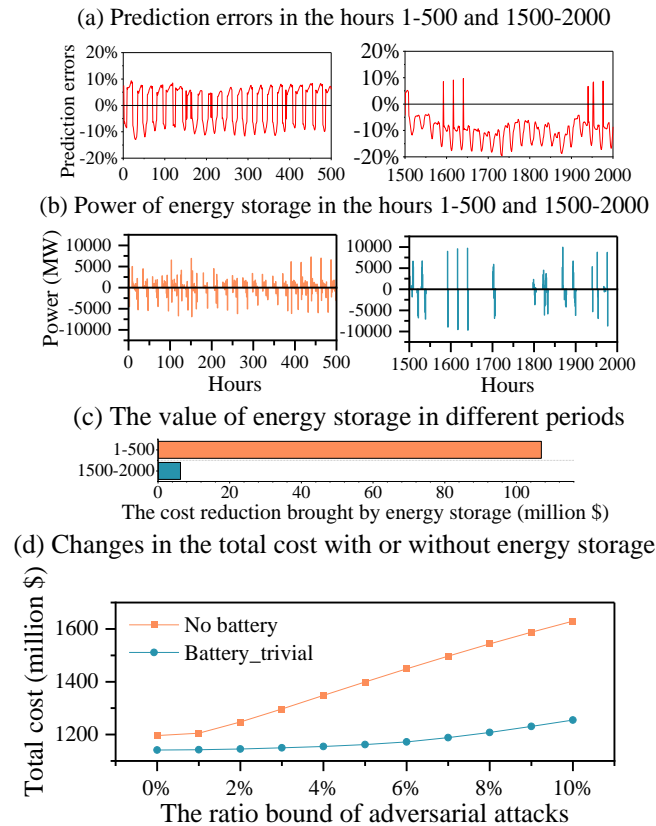

**Fig. 5. Energy storage output and total cost after adversarial attack. (a) Actual load and forecasted load after attack ( $\epsilon = 3\%$ ) in the hours 1-500 and 1500-2000. (b) Charging and discharging of energy storage in the corresponding hours. (c) The cost reduction brought by energy storage in different periods. (d) Changes in the total cost with or without energy storage under varying degrees of attack.**

The changes in the total cost with or without ES under varying degrees of attack are compared in Fig. 5 (d). The total cost has risen sharply with the increase in the degree of attack without the ES, while the total cost has only slightly increased with ES. Moreover, the higher the attack degree, the greater the cost reduction brought by ES. This is because ES can effectively enhance the ability of loss hours to resist attacks. Compared Fig. 3 (c) with Fig. 3 (a), the red part almost disappears after ES participates and all hours become unchanged hours. Therefore, ES effectively enhances the system's ability to resist attacks every hour, and ultimately brings cost reductions.

### V. CONCLUSION

In this research, we reveal that the adversarial attack on load-forecast DNN model will bring a significant cost infla-

tion in the ERCOT market. However, the adversarial attack's impact varies over hours. The attack increases cost in some hours but decreases cost in others. We argue that the ERCOT has to care about venerable hours. We also found that the penetration of intermittent renewable energy will exacerbate the capability of an algorithmic adversarial attack on inflating generation cost. Thus, when power grid is decarbonized by deepening the penetration of wind and solar power, the grid becomes more venerable to adversarial attacks. We also demonstrate the capability of using physical facilities to fight against the algorithmic adversarial attack. Thus, our research proposed a novel perspective for adversarial research in the field of power grid study and IoT research.

In our future work, two issues deserve an in-depth study: 1) The application of physical facilities to defend cyber attacks will be extended to more practical scenarios. 2) It is worth to estimate the carbon footprint brought by such adversarial attacks for the power system.

### REFERENCES

- [1] Yann LeCun, Yoshua Bengio, and Geoffrey Hinton. Deep learning. *nature*, 521(7553): 436–444, 2015.
- [2] Athanasios Voulodimos, Nikolaos Doulamis, Anastasios Doulamis, and Eftychios Protopapadakis. Deep learning for computer vision: A brief review. *Computational intelligence and neuroscience*, 2018, 2018.
- [3] Tom Young, Devamanyu Hazarika, Soujanya Poria, and Erik Cambria. Recent trends in deep learning based natural language processing. *IEEE Computational Intelligence Magazine*, 13(3): 55–75, 2018.
- [4] Yuxian Qiu, Jingwen Leng, Cong Guo, Quan Chen, Chao Li, Minyi Guo, and Yuhao Zhu. Adversarial defense through network profiling based path extraction. In *Proceedings of the IEEE Conference on Computer Vision and Pattern Recognition*, pages 4777–4786, 2019.
- [5] Seyed-Mohsen Moosavi-Dezfooli, Alhussein Fawzi, and Pascal Frossard. Deepfool: a simple and accurate method to fool deep neural networks. In *Proceedings of the IEEE conference on computer vision and pattern recognition*, pages 2574–2582, 2016.
- [6] Aleksander Madry, Aleksandar Makelov, Ludwig Schmidt, Dimitris Tsipras, and Adrian Vladu. Towards deep learning models resistant to adversarial attacks. *arXiv preprint arXiv:1706.06083*, 2017.
- [7] Yize Chen, Yushi Tan, and Baosen Zhang. Exploiting vulnerabilities of load forecasting through adversarial attacks. In *Proceedings of the Tenth ACM International Conference on Future ES Systems*, pages 1–11, 2019.
- [8] L. Garcia, F. Brasser, M. H. Cintuglu, A.-R. Sadeghi, O. Mohammed and S. A. Zonouz, "Hey my malware knows physics! attacking plcs with physical model aware rootkit", *Proc. Netw. Distrib. Syst. Secur. Symp.*, 2017.
- [9] Y. Yuan, Z. Li and K. Ren, "Modeling load redistribution attacks in power systems", *IEEE Trans. Smart Grid*, vol. 2, no. 2, pp. 382-390, Jun. 2011.
- [10] A.-H. Mohsenian-Rad and A. Leon-Garcia, "Distributed internet-based load altering attacks against smart power grids", *IEEE Trans. Smart Grid*, vol. 2, no. 4, pp. 667-674, Dec. 2011.
- [11] S. Amini, F. Pasqualetti and H. Mohsenian-Rad, "Dynamic load altering attacks against power system stability: Attack models and protection schemes", *IEEE Trans. Smart Grid*, vol. 9, no. 4, pp. 2862-2872, Jul. 2018.
- [12] Li, J. , et al. "Towards Adversarial-Resilient Deep Neural Networks for False Data Injection Attack Detection in Power Grids." , 2021.
- [13] Aleksander Madry, Aleksandar Makelov, Ludwig Schmidt, Dimitris Tsipras, and Adrian Vladu. Towards deep learning models resistant to adversarial attacks. *arXiv preprint arXiv:1706.06083*, 2017.
- [14] Electric Reliability Council of Texas market (ERCOT). Wind power production: Hourly averaged actual and forecasted values 2012[EB/OL]. 2012. <http://www.ercot.com/gridinfo/generation/>.
- [15] Renewable.ninja 2012. <https://www.renewables.ninja>